

Setting up for the 2020s

Addressing South Africa's electricity crisis and getting ready for the next decade

CSIR Energy Centre

Pretoria. January 2020

v1.0

DR JARRAD WRIGHT

JOANNE CALITZ

CSIR
our future through science

Agenda

1	Executive Summary	2
2	The burning platform	18
3	Current plans (IRP 2019)	30
4	What if?	39
5	Mitigation options/solutions	45

What is being addressed in this contribution?

What is happening now and what will happen in the next 3-5 years?

Is South Africa in an electricity crisis^{1,2}?

How long will loadshedding last?

What options are available to solve the electricity crisis³?

What is CSIR addressing?

Assessing whether this is an **electricity crisis** (and the extent thereof)

Present two **scenarios** to understand the expected **intensity & duration of loadshedding**

Proposing feasible options/solutions to alleviate the crisis and testing their impact

Focus is to analyse, interpret and present an evidence-base that can assist in supporting custodians & stakeholders to ensure short-term system adequacy³

¹ As announced by the President of South Africa ([March 2019](#)); ² Crises are (a) sources of uncertainty, disruption, and change, (b) harmful/threatening for organisations and stakeholders, (c) behavioural phenomena (socially constructed by actors involved) (d) parts of larger processes (rather than discrete events); ² As an individual household, as a business, as a regulator, as a policymaker/decision-maker; ³ It is not intended to address other topics in the electricity industry in South Africa e.g. financial sustainability & operational efficiency of institutions, political economy of stakeholders interacting on the basis of relevant interests.
Sources: Bundy

Why is CSIR making this contribution?

Independence

- CSIR is an independent scientific research institution with no vested interests in outcomes

Transparency

- CSIR has (over the years) developed & collated necessary data, analytics and modelling frameworks¹
- CSIR publish all analysis in this domain and intend to continue (public interest)²
- Providing an evidence-base to inform and aid planning for all custodians/stakeholders

Experience/expertise

- CSIR is highly proficient/competent in this domain with well respected capabilities
- CSIR is well positioned to undertake this suite of analysis as a publicly trusted independent institution

Expedience

- South Africa is in an electricity crisis³
- CSIR is already engaging with key custodians/stakeholders & intends to formally engage further to assist in driving expedited responses/actions by various custodians/stakeholders⁴

¹ Public domain information; ² As with previous analyses in this domain e.g. Draft IRP 2016, Draft IRP 2018, IRP 2019 (amongst others); ³ As announced by the President of South Africa ([March 2019](#)); ⁴ DMRE RMPPPP RfI is in the public domain (closing date 31 January 2020) with RfP to follow (publication for all custodians/stakeholders will inform responses, reduce risk and allow for more informed procurement)

The burning platform & need for an urgent response requires a widely understood evidence-base for all custodians/stakeholders to take action

South Africa had the worst year of loadshedding on record in 2019 (1352 GWh, 530 hours) with up to Stage 6 load shedding being implemented having significant impacts on the economy (≈R 60-120 bln)

Loadshedding is expected to continue for 2-3 years depending on key decisions/actions


An urgent response is necessary to ensure short-term adequacy and set South Africa on a path towards long-term adequacy in the 2020s

Systemic changes in Eskom fleet performance (EAF) expectation and demand forecast requires an updated understanding of capacity & energy gap relative to IRP 2019 assumptions¹ (as will be shown)

¹ Even if Medupi, Kusile, REIPPPP capacity under construction comes online as expected; EAF – Energy Availability Factor

2019 was the most intensive year of loadshedding to date in South Africa with Stage 6 being implemented in December 2019

Load shed [GWh]

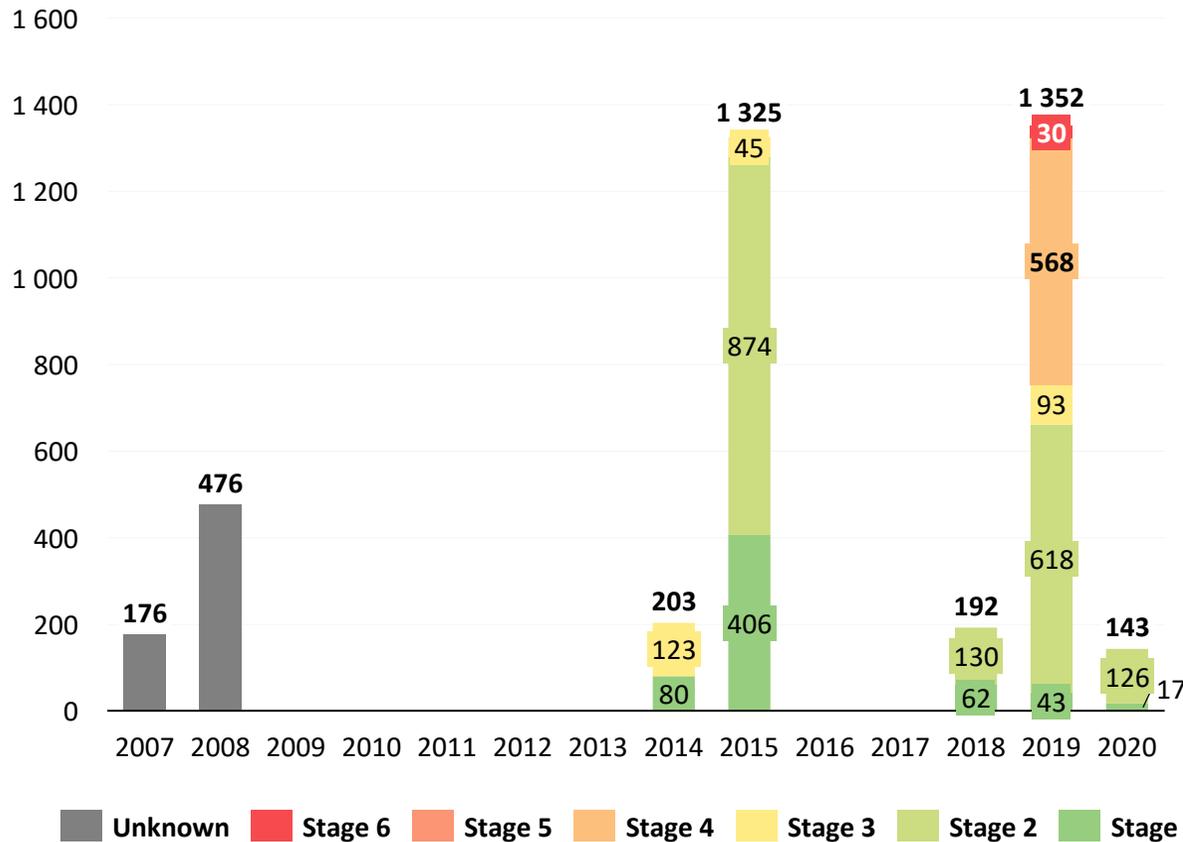

Year	Duration of outages (hours)	Energy shed (GWh)	Est. econ. Impact (ZAR-bln)
2007	-	176	8-15
2008	-	476	21-42
....
2014	121	203	9-18
2015	852	1325	58-116
2016	-	-	-
2017	-	-	-
2018	127	192	8-17
2019	530	1352	59-118
2020 (YTD)	80	143	6-12

Notes: Load shedding assumed to have taken place for the full hours in which it was implemented. Practically, load shedding (and the Stage) may occasionally change/ end during a particular hour; Total GWh calculated assuming Stage 1 = 1 000 MW, Stage 2 = 2 000 MW, Stage 3 = 3 000 MW, Stage 4 = 4 000 MW, Stage 5 = 5 000 MW, Stage 6 = 6 000 MW; Cost to the economy of load shedding is estimated using COUE (cost of unserved energy) = 87.50 R/kWh

Sources: Eskom Twitter account; Eskom se Push (mobile app); Nersa; CSIR analysis


System inadequacy has been highlighted recently by DMRE and Eskom – but no specific solutions/interventions provided (yet)

Integrated Resource Plan 2019 (IRP 2019)

- Released: October 2019
- Highlighted short-term supply gap between 2019-2022
- Primarily due to lead-time of first new-build capacity in 2023


Medium-Term System Adequacy Outlook 2019 (MTSAO 2019)

- Released: November 2019
- Also highlighted lack of system adequacy if Eskom fleet EAF is below 72% for time horizon 2019-2024
- No new investments made in time-horizon

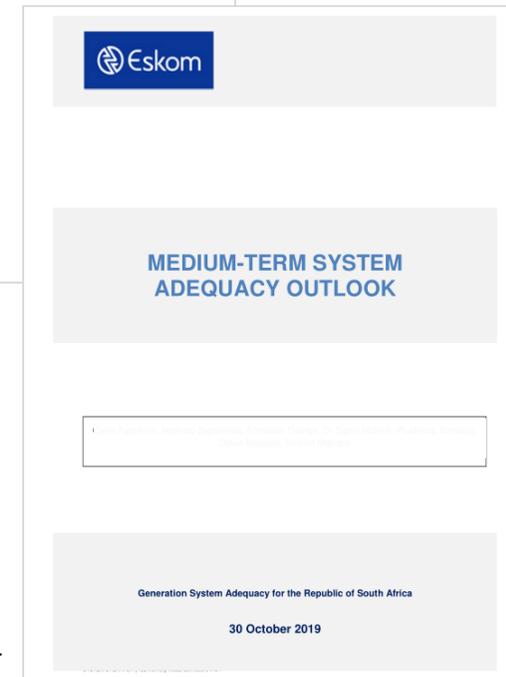

NOTE: Different assumptions made in a few dimensions for IRP 2019 and MTSAO 2019 (demand forecast, EAF, supply) but same conclusions reached.
Sources: DMRE; Eskom

Historical fleet EAF decline seems irreversable, IRP 2018 EAF has not materialised... risk of IRP 2019 or MTSAO 2019 EAF (High) not materialising?

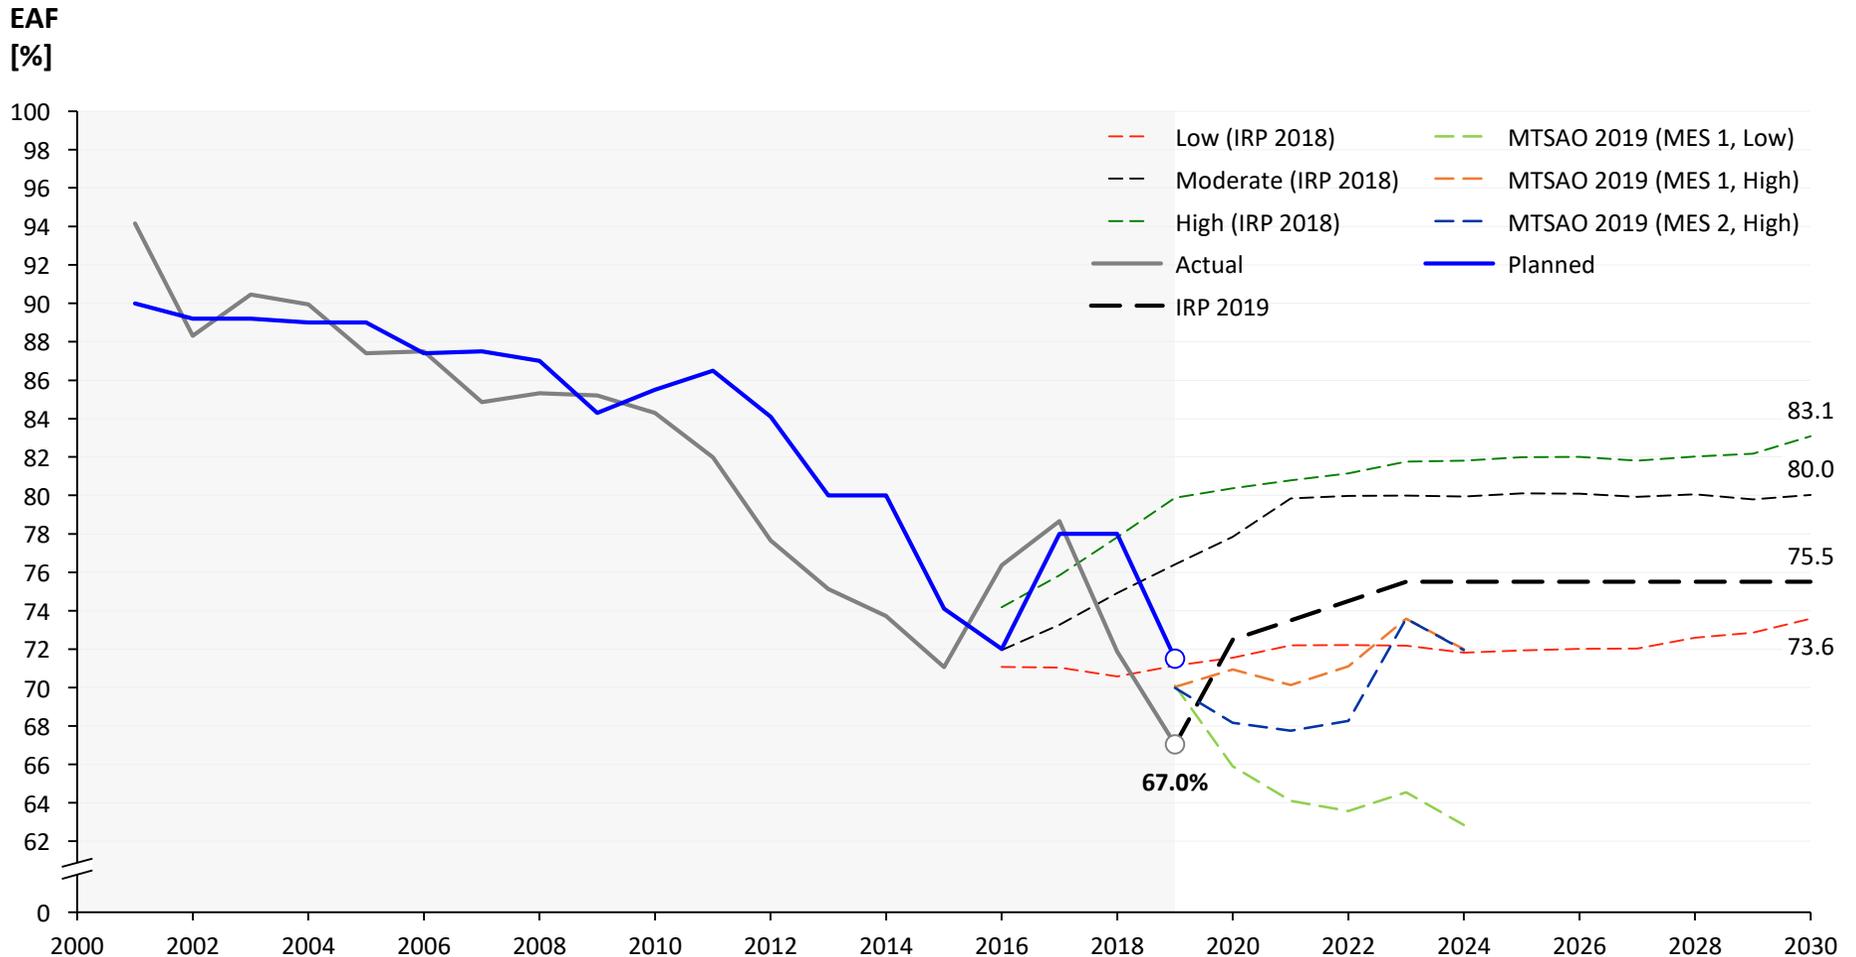


EAF – Energy Availability Factor; MTSAO – Medium-term System Adequacy Outlook

NOTE: 2019 EAF actual is YTD

Sources: Draft IRP 2018; IRP2019; Eskom; CSIR Energy Centre analysis

What if the demand forecast is lower than in IRP 2019 (very likely) and what if the Eskom fleet EAF is lower than in IRP 2019 (also very likely)?

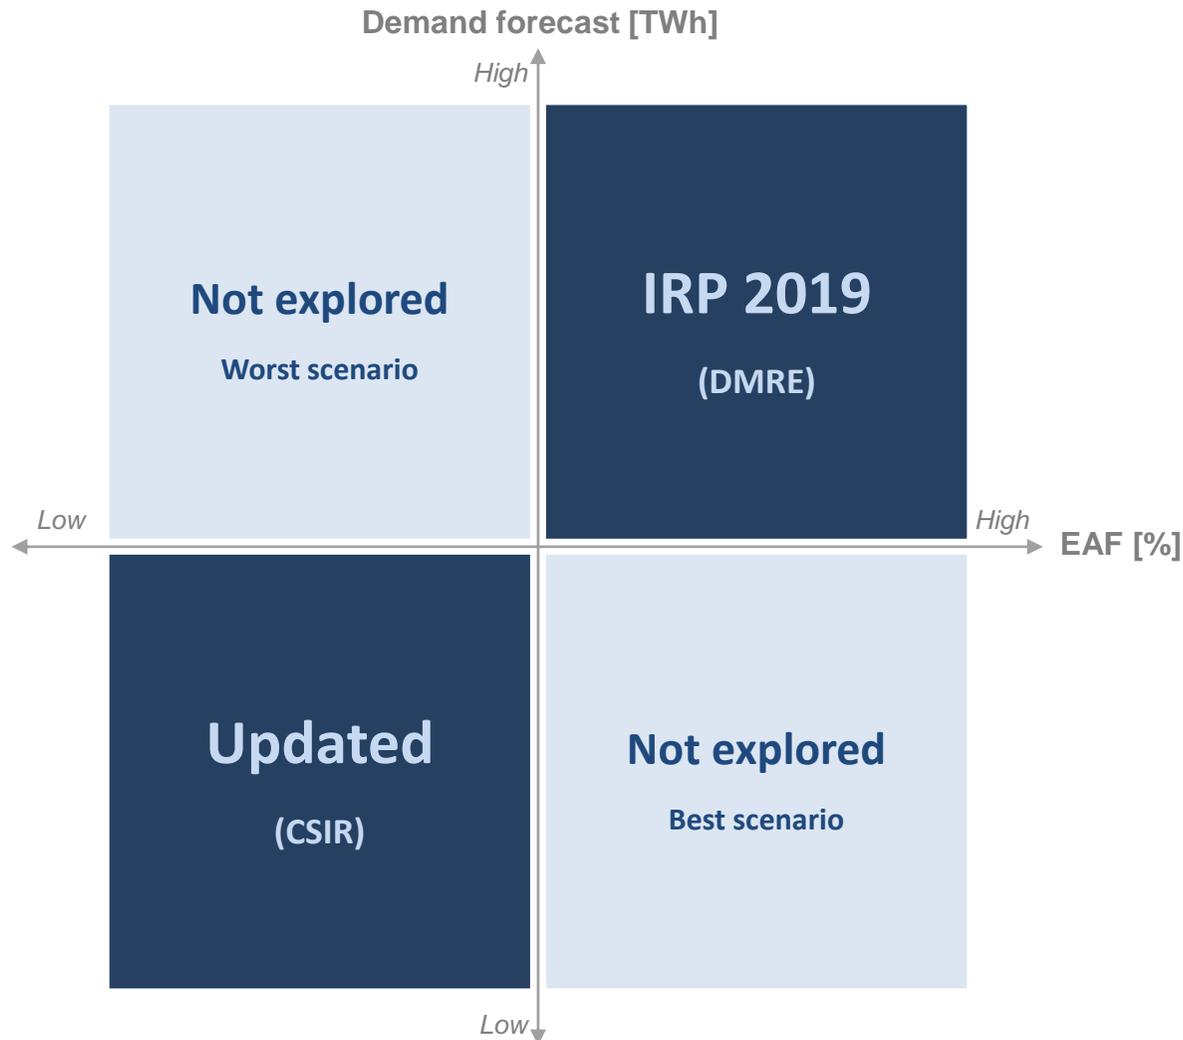


Sources: CSIR Energy Centre analysis

Would an updated EAF expectation and demand forecast make any difference to capacity and energy shortages?


EAF

Energy Availability Factor (EAF)
[%]

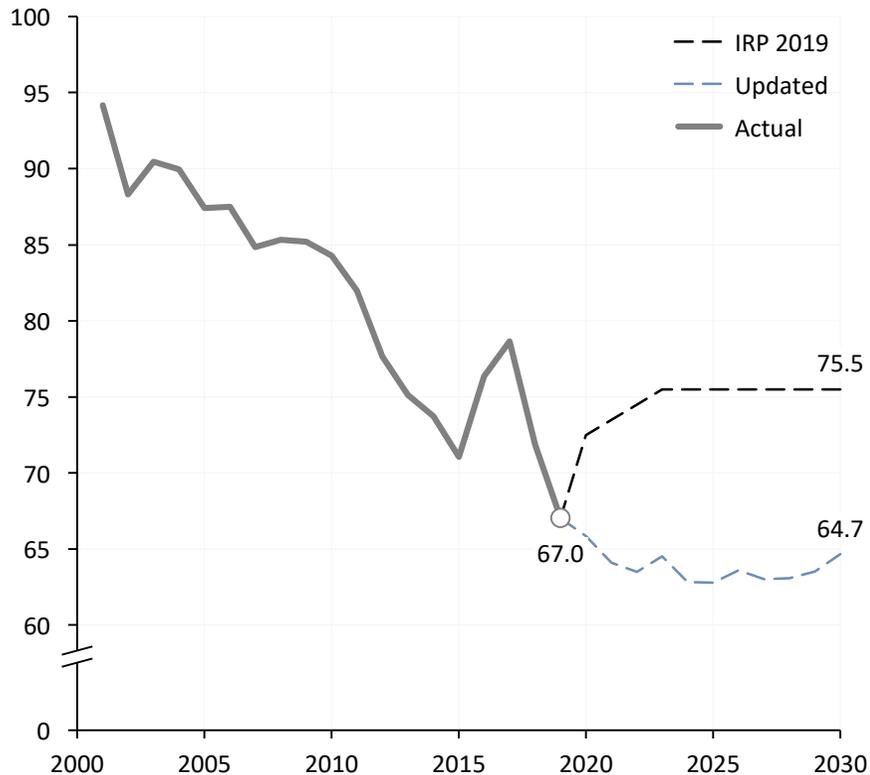

Demand forecast

Electrical energy demand
[TWh]

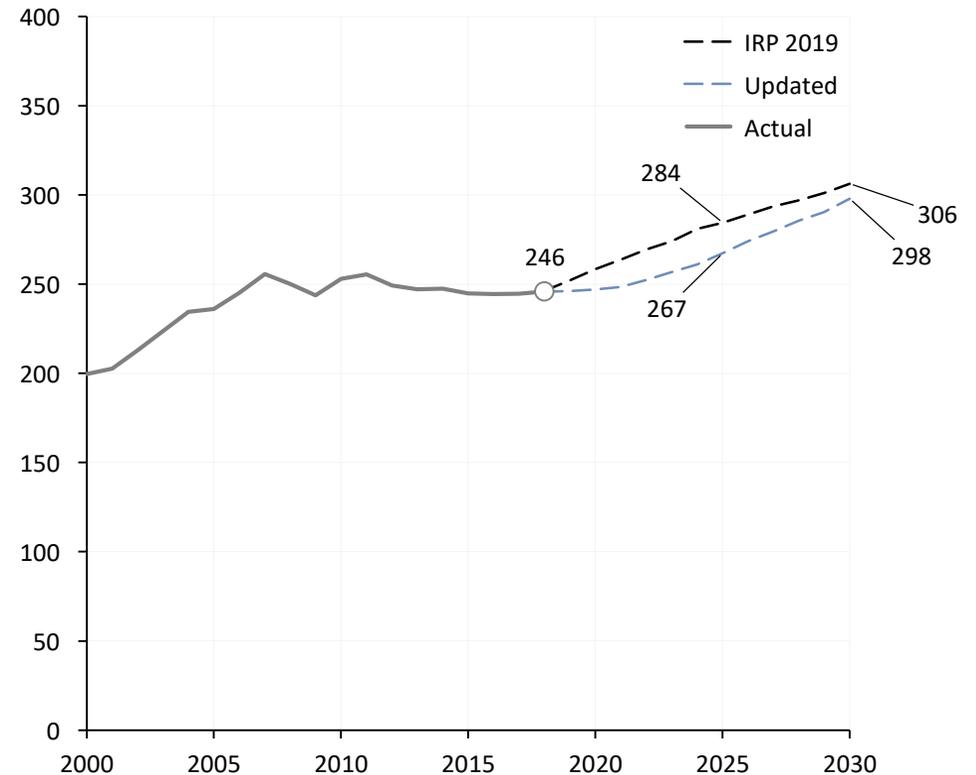


NOTE: "Updated" scenario is a test scenario developed by CSIR; Demand forecast is based on Eskom MTSAO demand forecast (until 2024) and IRP 2019 growth rates thereafter; Updated EAF based on MTSAO MES 1 (Low); EAF – Energy Availability Factor


Sources: IRP 2019; MTSAO; CSIR

Shortage from IRP 2019 indicating a dominant short-term capacity gap & small energy gap until planned new-build capacity comes online

Capacity (shortage)

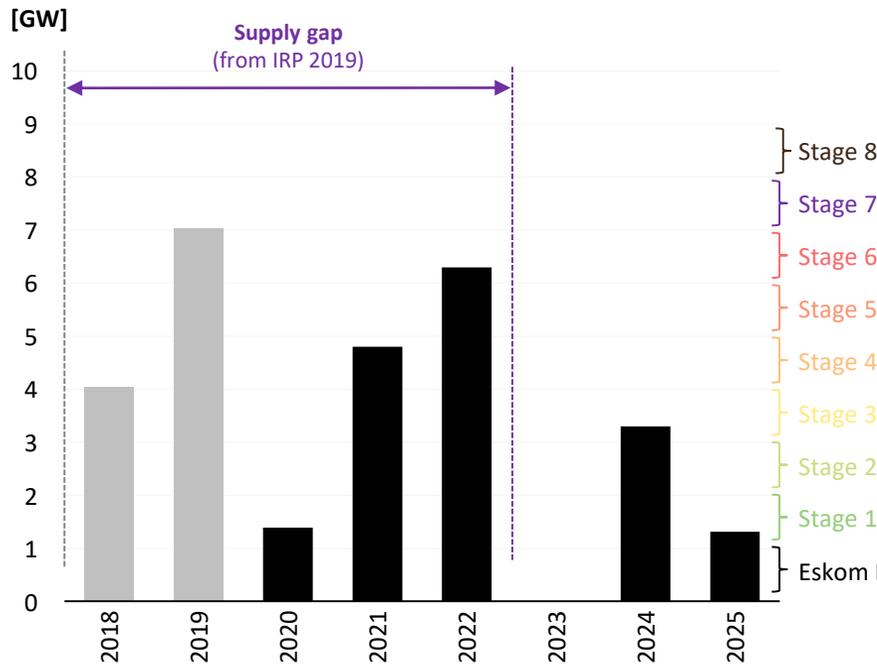

Energy (shortage)

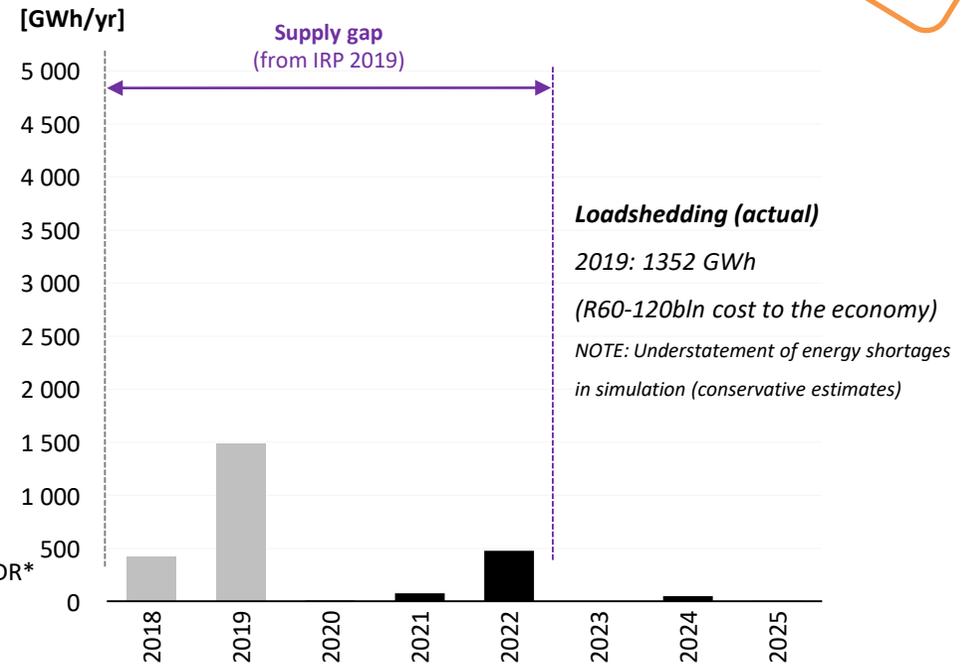

IRP 2019 (DMRE)

IRP 2019 EAF & IRP 2019 demand forecast


(EAF recovery from ≈67% in 2019 to 75.5% by 2024) (Demand forecast immediately growing to 284 TWh by 2025)

* Estimated Eskom Demand Response (DR) capability (mostly industrial & energy limited); NOTES: Energy & capacity shortage is demand that cannot be served due to a lack of capacity (including OCGTs, pumped storage & Eskom DR); Outcomes shown are from deterministic simulations - thus indicative; 99th percentile of capacity & energy shortage is reported; All IRP 2019 capacity is assumed to come online as planned (Step 3 is always considered implemented); Cost of load shedding is estimated using COUE (cost of unserved energy) = 87.50 R/kWh; Sources: CSIR Energy Centre analysis


Updated EAF & demand forecast indicates further shortage relative to IRP 2019 requiring capacity and significantly more energy

Updated (CSIR)

Capacity (shortage)

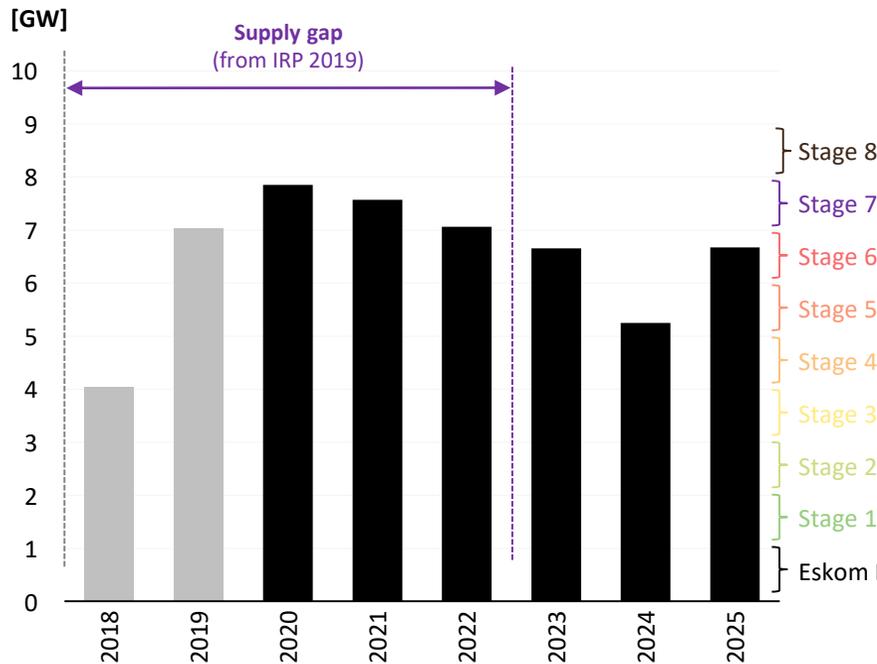

Energy (shortage)

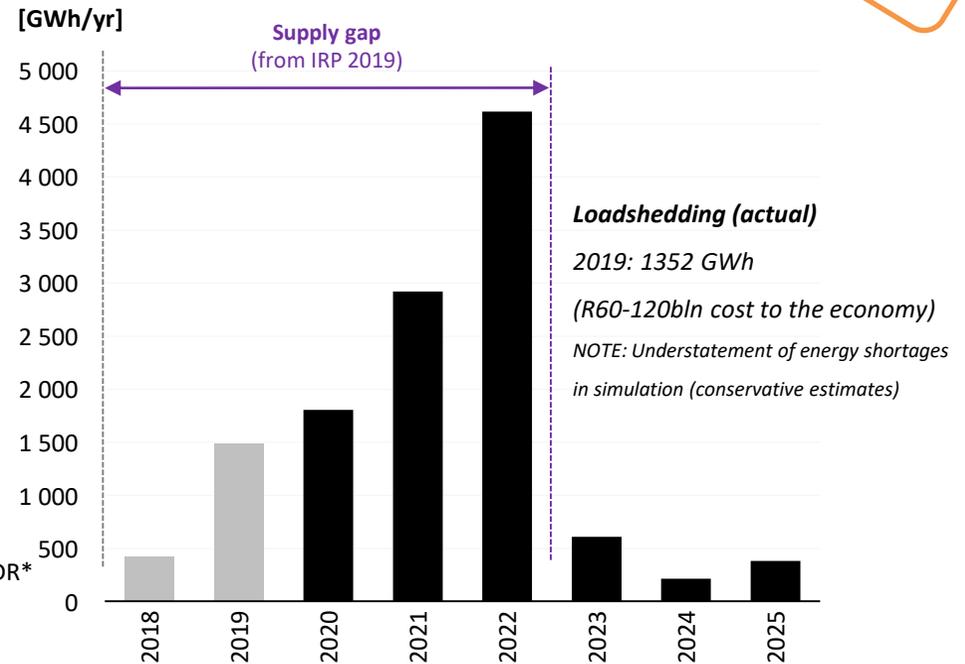

Updated EAF & Updated demand forecast

(EAF from ≈67% in 2019 to ≈64% by 2024) (Demand forecast initially flat & growth to 267 TWh by 2025)


* Estimated Eskom Demand Response (DR) capability (mostly industrial & energy limited); NOTES: Energy & capacity shortage is demand that cannot be served due to a lack of capacity (including OCGTs, pumped storage & Eskom DR); Outcomes shown are from deterministic simulations - thus indicative; 99th percentile of capacity & energy shortage is reported; All IRP 2019 capacity is assumed to come online as planned (Step 3 is always considered implemented); Cost of load shedding is estimated using COUE (cost of unserved energy) = 87.50 R/kWh; Sources: CSIR Energy Centre analysis

Criteria to decide on options to meet the short-term gap should be informed and applied consistently to ensure reasonable cost & timeous delivery

Criteria for choice of short-term options available can ensure a portfolio of options:

- 1 Can be supply-side, demand-side and/or storage
- 2 Can be delivered in 1-2 years
- 3 Will not require extensive procurement process (lead-time)
- 4 Can meet capacity (MW) and/or energy needs (MWh)
- 5 Can be contracted for 1-3 years (or more if aligned with long-term energy mix)
- 6 Ease of implementation (does not require extensive regulatory reform/change)
- 7 Aligned with long-term energy mix pathways (technology choices)
- 8 Does not require extensive network expansion or augmentation for interconnection

Critical decisions/actions needed now along with accelerated processes to ensure timeous implementation allowing RSA to ramp into 2020s successfully

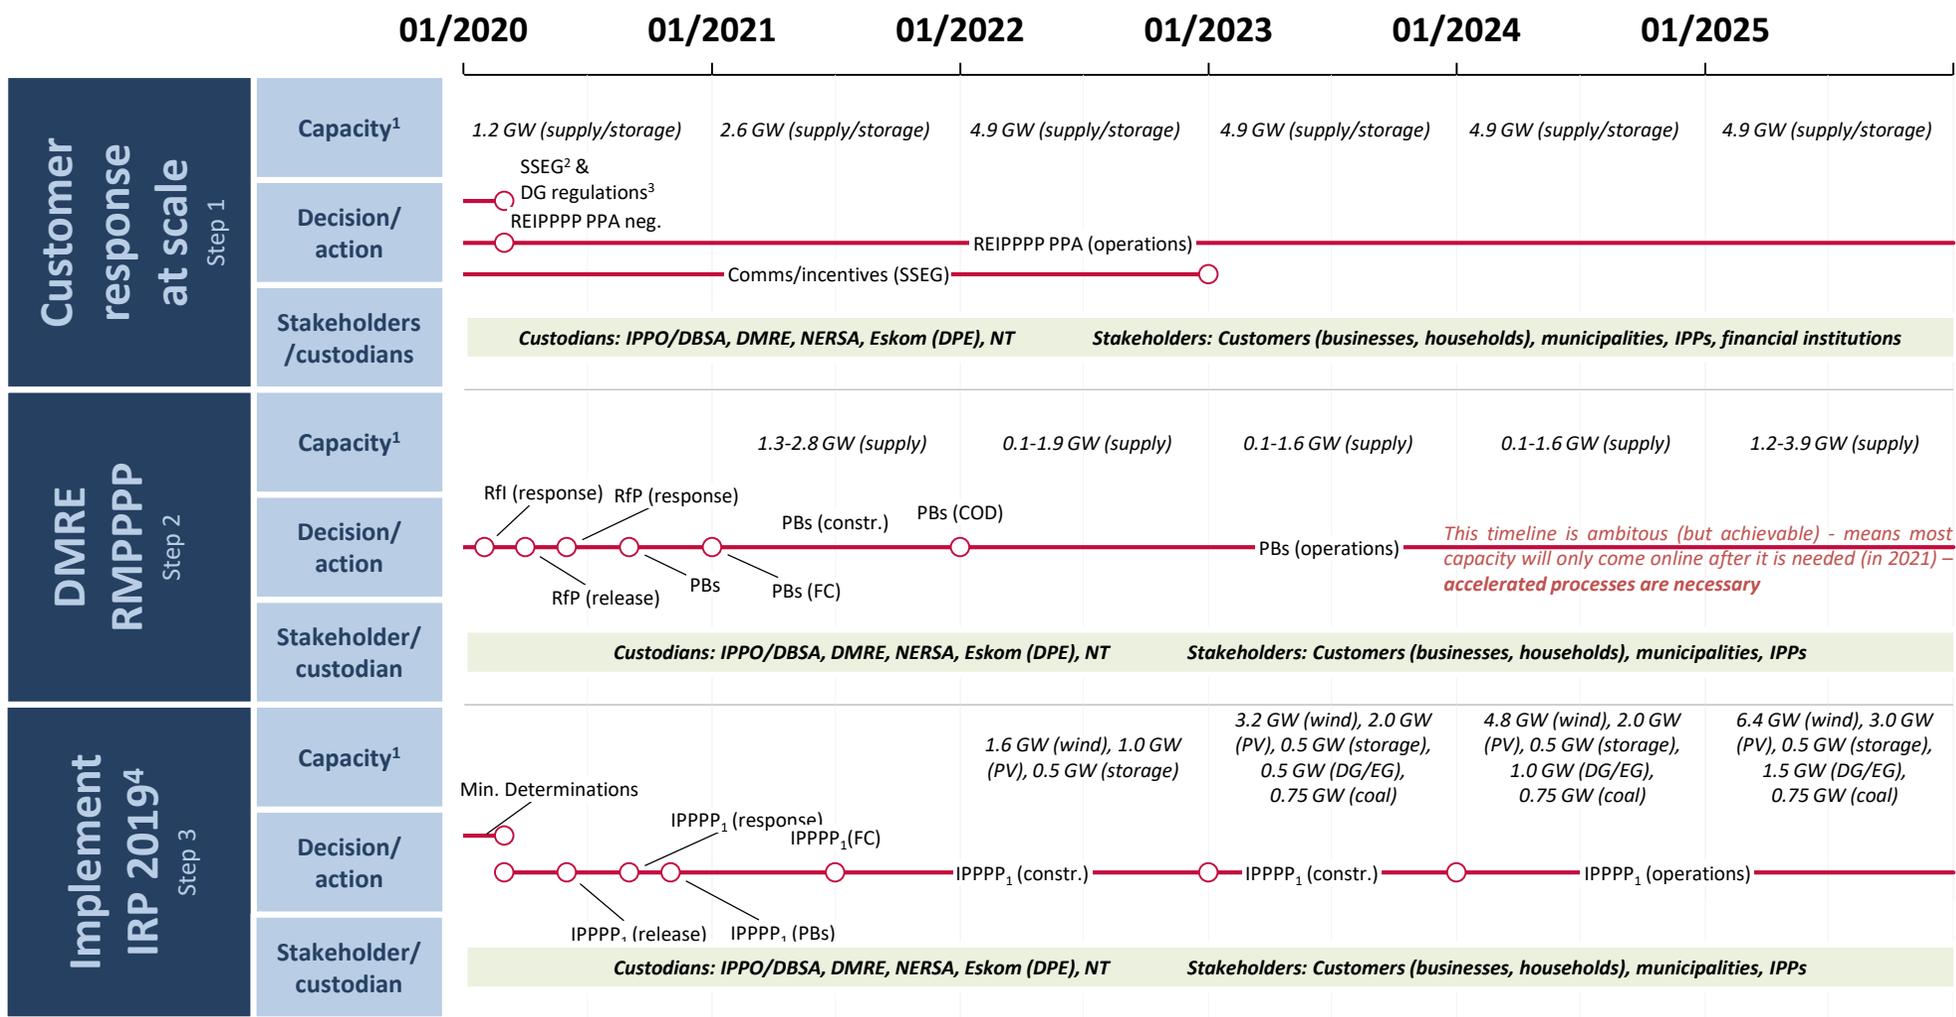

NOTES: Timelines are estimated and in no way prescriptive; PBs – Preferred bidders, PPA – Power Purchase Agreement; RfI – Request for Information; RfP – Request for Proposal; FC – Financial Close, COD – Commercial Operations Date; ¹ Total additional installed capacity; ² Requires adjusted SSEG regulations (proposed lifting licensing requirement for SSEG & only requiring registration with NERSA - from 1 MW to 10 MW (or more)); ³ SSEG (res.) does not require regulatory changes (just communications rollout but could be further incentivised by Eskom/municipalities); ⁴ Will require Ministerial Determination - generators expected >10 MW (technologies aligned with IRP 2019); ⁵ Unlikely to get capacity online before 2023-2024 (risk of misalignment with IRP 2019)

Step 1 is the only immediate feasible response as Step 2 & 3 are expected from 2022/2023 only (best case) but still critical to ensure system adequacy

Key recommendations

	DECISION/ACTION	IMPACT
Customer response at scale Step 1	<p>Immediate focus on customer response at scale (self-supply) in all customer segments via enabling regulations (easy to implement)</p> <p><i>Driven by SSEG (residential), EG (commercial/agricultural), EG/DG (industrial/mining), municipalities & storage, REIPPPP 'power-up'</i></p>	<ul style="list-style-type: none"> • Immediate reduced load shedding as capacity can come online in 2020 already • Further assistance from 2021 onwards as more capacity comes online
DMRE RMPPPP Step 2	<p>Accelerate DMRE RMPPPP process to address remaining capacity & energy gap and ensure capacity can come online timeously</p> <p><i>An accelerated process necessary due to immediate shortages & should be based on estimated required capacity (complementing Step 1)</i></p>	<ul style="list-style-type: none"> • Capacity online from 2022 only (mid-2021 with accelerated DMRE RMPPPP process) • Further reduction in load shedding once capacity comes online
Implement IRP 2019 ⁴ Step 3	<p>Immediate focus on Ministerial Determinations for all technologies in IRP 2019 followed by procurement process to ensure timeous implementation</p> <p><i>Due to procurement processes & technology specific lead-times this action/decision is required now</i></p>	<ul style="list-style-type: none"> • First capacity online from 2023 only (best case) but required in 2022 (as per IRP 2019) • Adequate power system into mid-2020s as existing capacity is decommissioned if IRP 2019 planned new-build capacity comes online

NOTE: Even with short-term interventions, if EAF does not recover to IRP 2019 levels, shortage is expected in 2020-2021 depending on capacity that can feasibly come online, structural load shedding may still need to be considered for 2-3 years (shortages exaggerated in Updated scenario)

This is a crisis - get capacity under construction online, recover Eskom plant performance AND implement all steps with urgency

Key recommendations

Ensure capacity under construction is delivered as planned (Medupi/Kusile, REIPPPP)

Recover Eskom fleet EAF to realistic levels whilst ensuring value for money relative to alternatives

Implement/enable 3 steps concurrently and with urgency:

- **Step 1:** Intentionally drive a customer response at scale (with enabling regulations) driven by SSEG (residential), EG (commercial/agricultural), EG/DG (industrial/mining) & storage¹
- **Step 2:** Address remaining capacity/energy gap via an accelerated DMRE RMPPPP process to ensure capacity is online when required
- **Step 3:** Continued implementation of IRP 2019 as an immediate focus to ensure sufficient lead-time for procurement processes and technology specific construction lead-times

¹ As shown, these are the only options/solutions that would assist in mitigating load shedding in the next 2-3 years (other options/solutions would take further time to implement). SSEG – Small-Scale Embedded Generation; DG – Distributed Generation; EG – Embedded Generation; RMPPPP – Risk Mitigation Power Purchase Procurement Programme; NOTE: For further details – please refer to the remainder of this presentation; SSEG could include a range of technologies but would be dominated by solar PV.

Urgency required on actions/decisions now to ensure capacity comes online timeously

Key recommendations

In order to enable and implement recommended steps, first immediate decisions/actions are needed:

Q1-2020

- **DMRE/Nersa** to update regulations to enable streamlined & expedited self-supply options¹
- **DMRE/Nersa** to publish Ministerial Determinations and/or update EG/DG regulations to enable DMRE RMPPPP additional capacity
- **DMRE/Nersa** to publish Ministerial Determinations aligned with IRP 2019
- **IPPO** engage & implement feasible existing REIPPPP PPA negotiations (REIPPPP ‘power-up’)
- **Various stakeholders** to drive intentional communications program and/or incentives for SSEG deployment (res./com./agri. focus)²
- **IPPO** to run bid windows for new-build procurement (technologies aligned with IRP 2019) and undertake annually going forward

IPPO – Independent Power Producers Office; DMRE – Department of Mineral Resources and Energy; res. – residential; com. – commercial.


¹ Adjusted/updated SSEG regulations (proposed lifting licensing requirement for SSEG & only requiring registration with NERSA - from 1 MW to 10 MW (or more)); ² SSEG (res./com.) does not require regulatory changes (just communications rollout but could be further incentivised by Eskom/municipalities with appropriate tariffs).

Agenda

1	Executive Summary	2
2	The burning platform	18
3	Current plans (IRP 2019)	30
4	What if?	39
5	Mitigation options/solutions	45

2019 has been the most intensive year of loadshedding to date with Stage 6 being implemented in December 2019

Load shed [GWh]

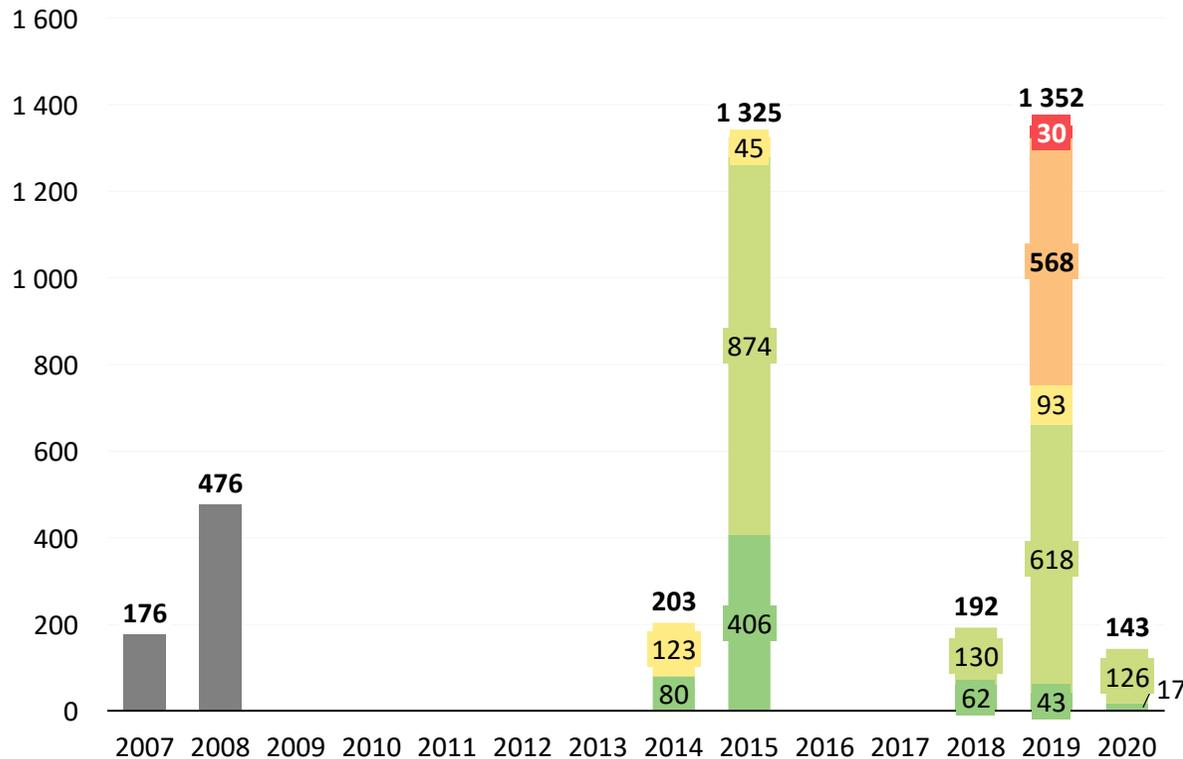

Year	Duration of outages (hours)	Energy shed (GWh)	Est. econ. Impact (ZAR-bln)
2007	-	176	8-15
2008	-	476	21-42
....
2014	121	203	9-18
2015	852	1325	58-116
2016	-	-	-
2017	-	-	-
2018	127	192	8-17
2019	530	1352	59-118
2020 (YTD)	80	143	6-12

Unknown Stage 6 Stage 5 Stage 4 Stage 3 Stage 2 Stage 1


Notes: Load shedding assumed to have taken place for the full hours in which it was implemented. Practically, load shedding (and the Stage) may occasionally change/ end during a particular hour; Total GWh calculated assuming Stage 1 = 1 000 MW, Stage 2 = 2 000 MW, Stage 3 = 3 000 MW, Stage 4 = 4 000 MW, Stage 5 = 5 000 MW, Stage 6 = 6 000 MW; Cost to the economy of load shedding is estimated using COUE (cost of unserved energy) = 87.50 R/kWh Sources: Eskom Twitter account; Eskom se Push (mobile app); Nersa; CSIR analysis

Hourly distribution of actual load shedding January to June 2019



Notes: Load shedding assumed to have taken place for the full hours in which it was implemented. Practically, load shedding (and the Stage) may occasionally change/ end during a particular hour; Total GWh calculated assuming Stage 1 = 1 000 MW, Stage 2 = 2 000 MW, Stage 3 = 3 000 MW, Stage 4 = 4 000 MW, Stage 5 = 5 000 MW, Stage 6 = 6 000 MW; Cost to the economy of load shedding is estimated using COUE (cost of unserved energy) = 87.50 R/kWh
 Sources: Eskom Twitter account; Eskom se Push (mobile app); Nersa; CSIR analysis



Hourly distribution of actual load shedding July to December 2019

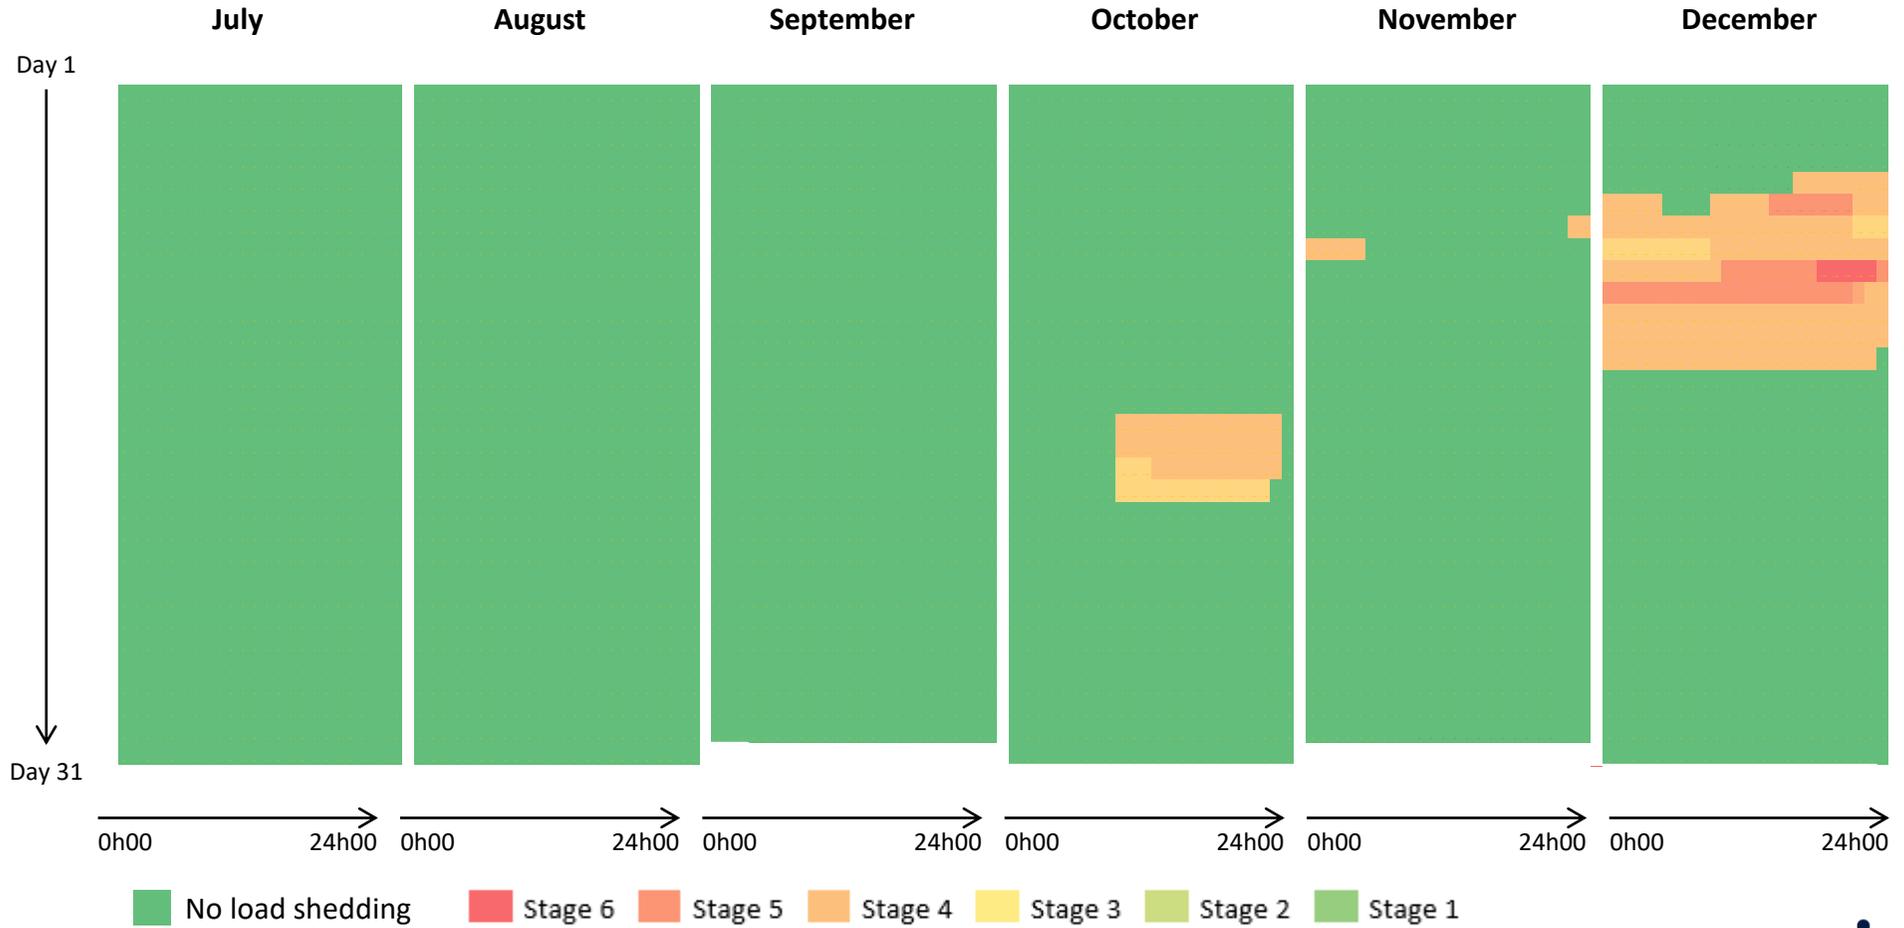

Notes: Load shedding assumed to have taken place for the full hours in which it was implemented. Practically, load shedding (and the Stage) may occasionally change/ end during a particular hour; Total GWh calculated assuming Stage 1 = 1 000 MW, Stage 2 = 2 000 MW, Stage 3 = 3 000 MW, Stage 4 = 4 000 MW, Stage 5 = 5 000 MW, Stage 6 = 6 000 MW; Cost to the economy of load shedding is estimated using COUE (cost of unserved energy) = 87.50 R/kWh
 Sources: Eskom Twitter account; Eskom se Push (mobile app); Nersa; CSIR analysis

Severely constrained system from 4 December 2019, compounded by further breakdowns up to 9 December 2019 resulting in Stage 6 loadshedding


Actual hourly production from all power supply sources in RSA for December 2019

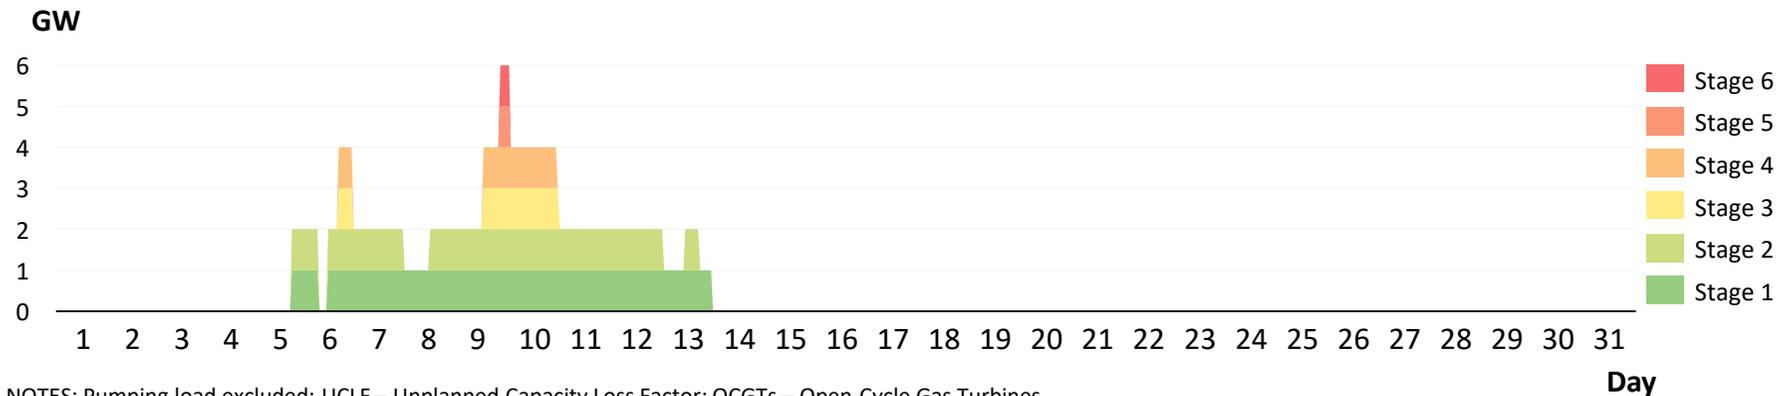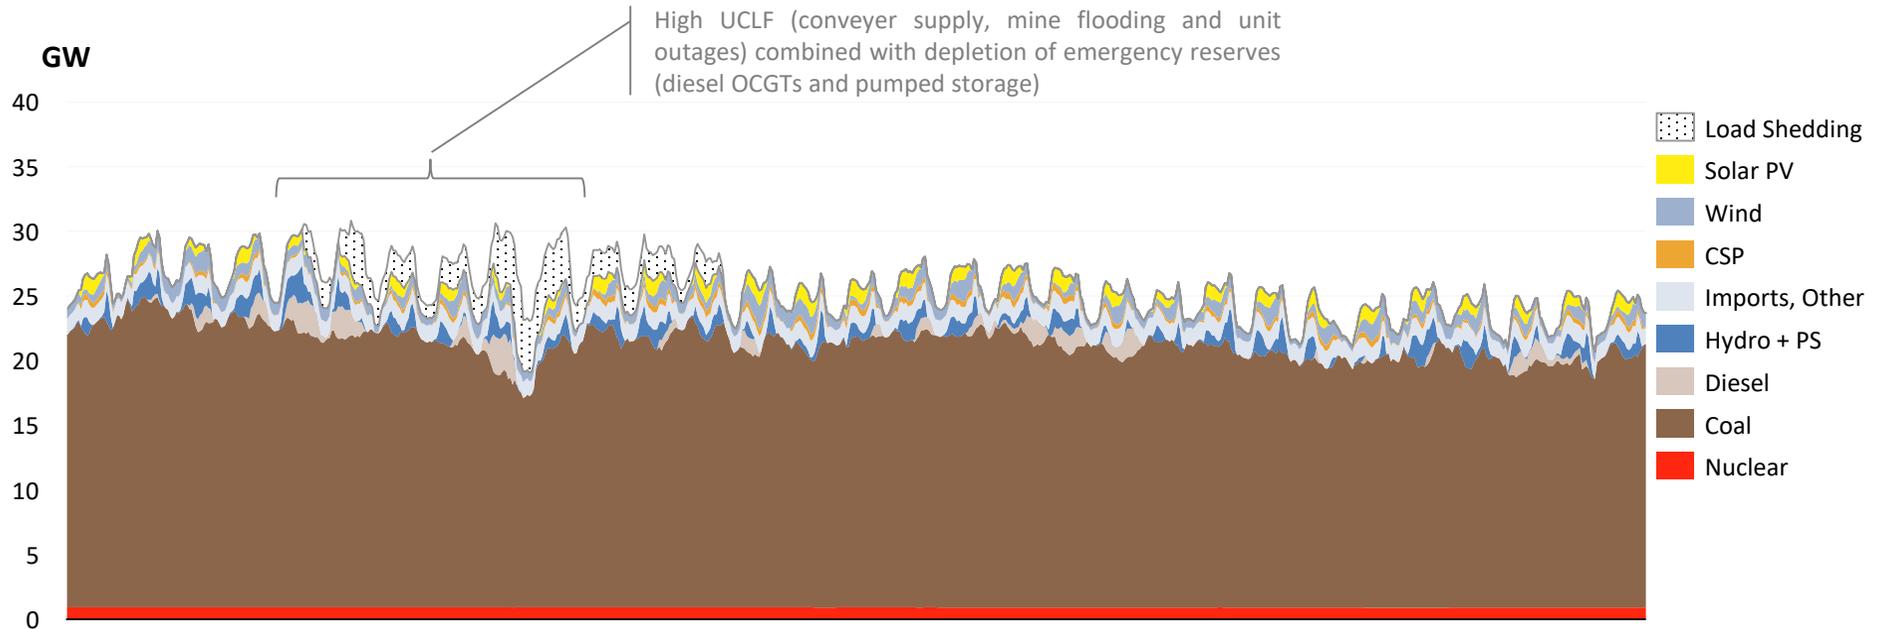

NOTES: Pumping load excluded; UCLF – Unplanned Capacity Loss Factor; OCGTs – Open-Cycle Gas Turbines
Sources: Eskom; CSIR Energy Centre analysis

Day

South African supply-demand balance is maintained by the System Operator (Eskom) with some supply/demand responsive customers

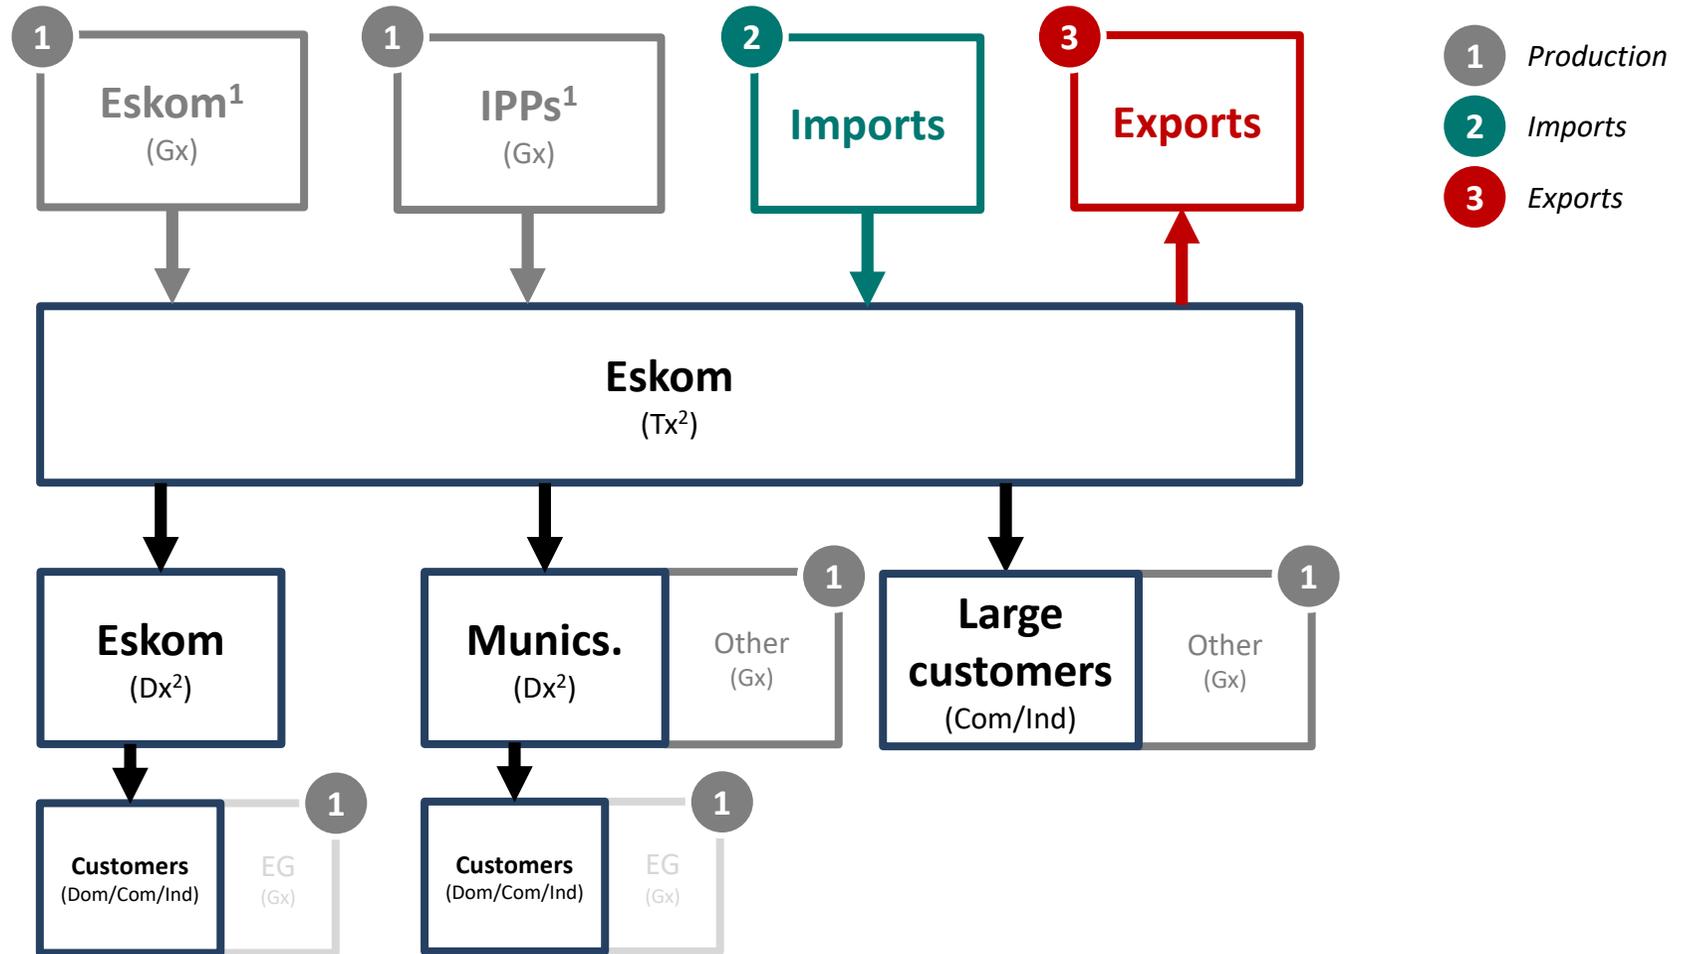


EG = Embedded Generation; Gx = Generation; Tx = Transmission; Dx = Distribution

¹ Power generated less power station load; Minus pumping load (Eskom owned pumped storage); ² Transmission/distribution networks incur losses before delivery to customers

Historical fleet EAF decline since 2001 with apparent recovery in 2016-2017 but trend continued thereafter and is at ≈67% for 2019

EAF (annual)
[%]

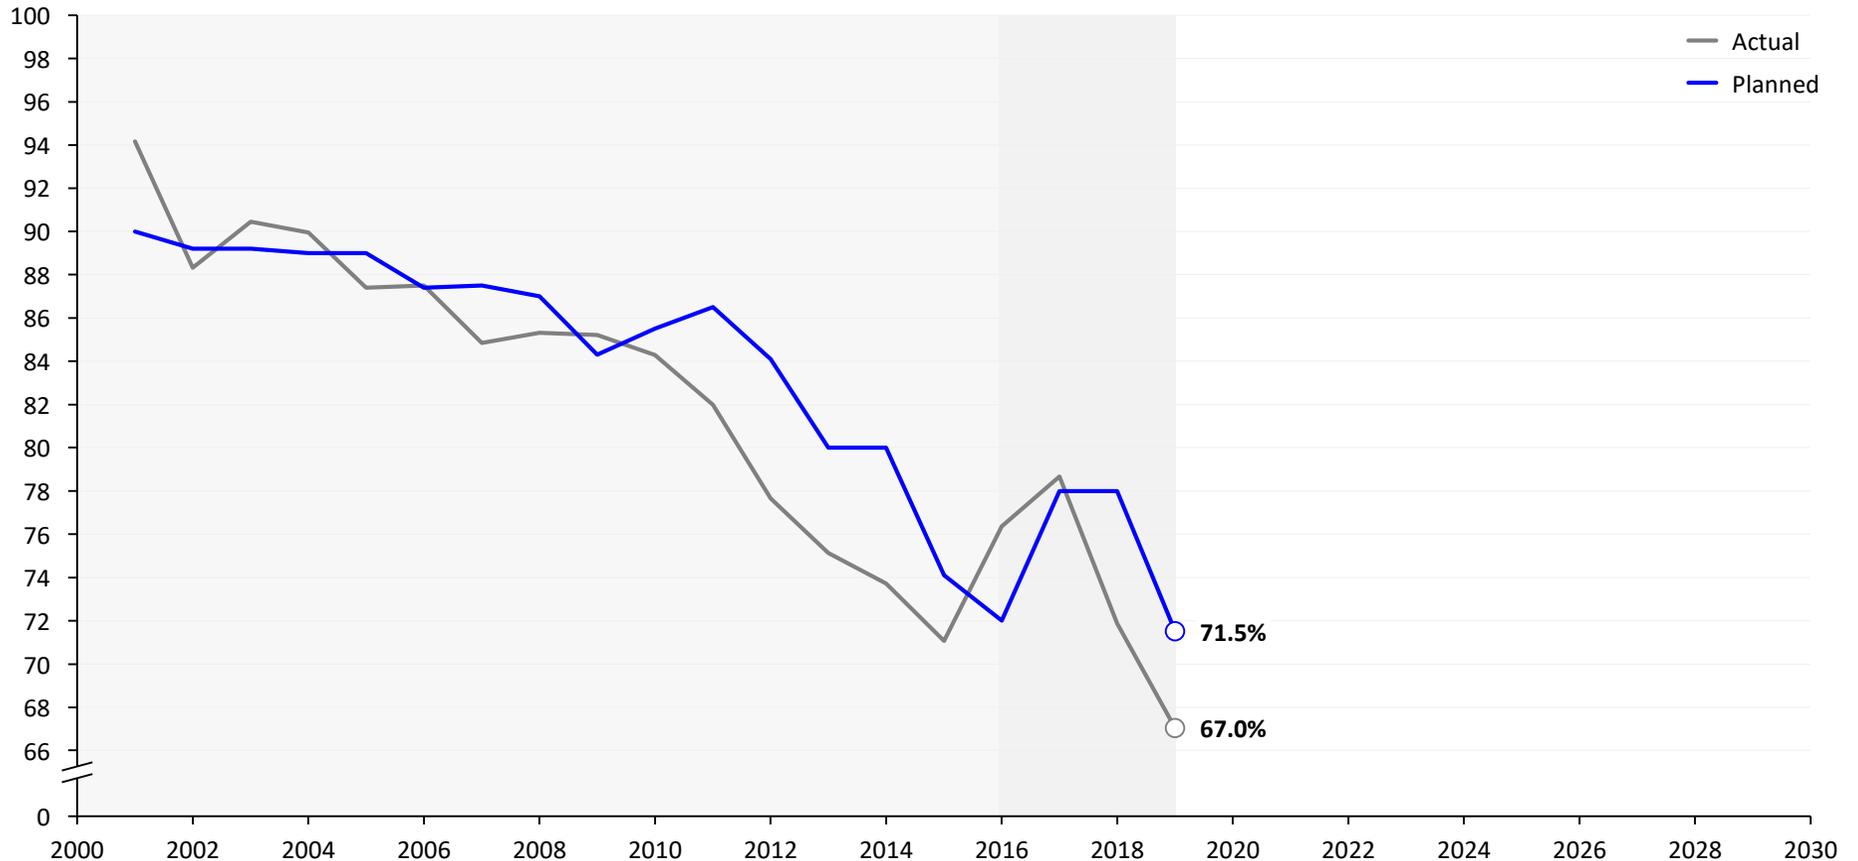

EAF – Energy Availability Factor

NOTE: 2019 EAF actual is YTD

Sources: IRP2019; Eskom; CSIR Energy Centre analysis


Recent Eskom weekly fleet EAF has been declining with unfortunate consequences of a highly constrained power system



NOTES: EAF - Energy Availability Factor
Sources: Eskom; CSIR Energy Centre analysis

Historical fleet EAF decline seems irreversible... IRP 2018 EAF has also not materialised, risk of IRP 2019 or MTSAO 2019 EAF (High) not materialising?

EAF (annual)
[%]

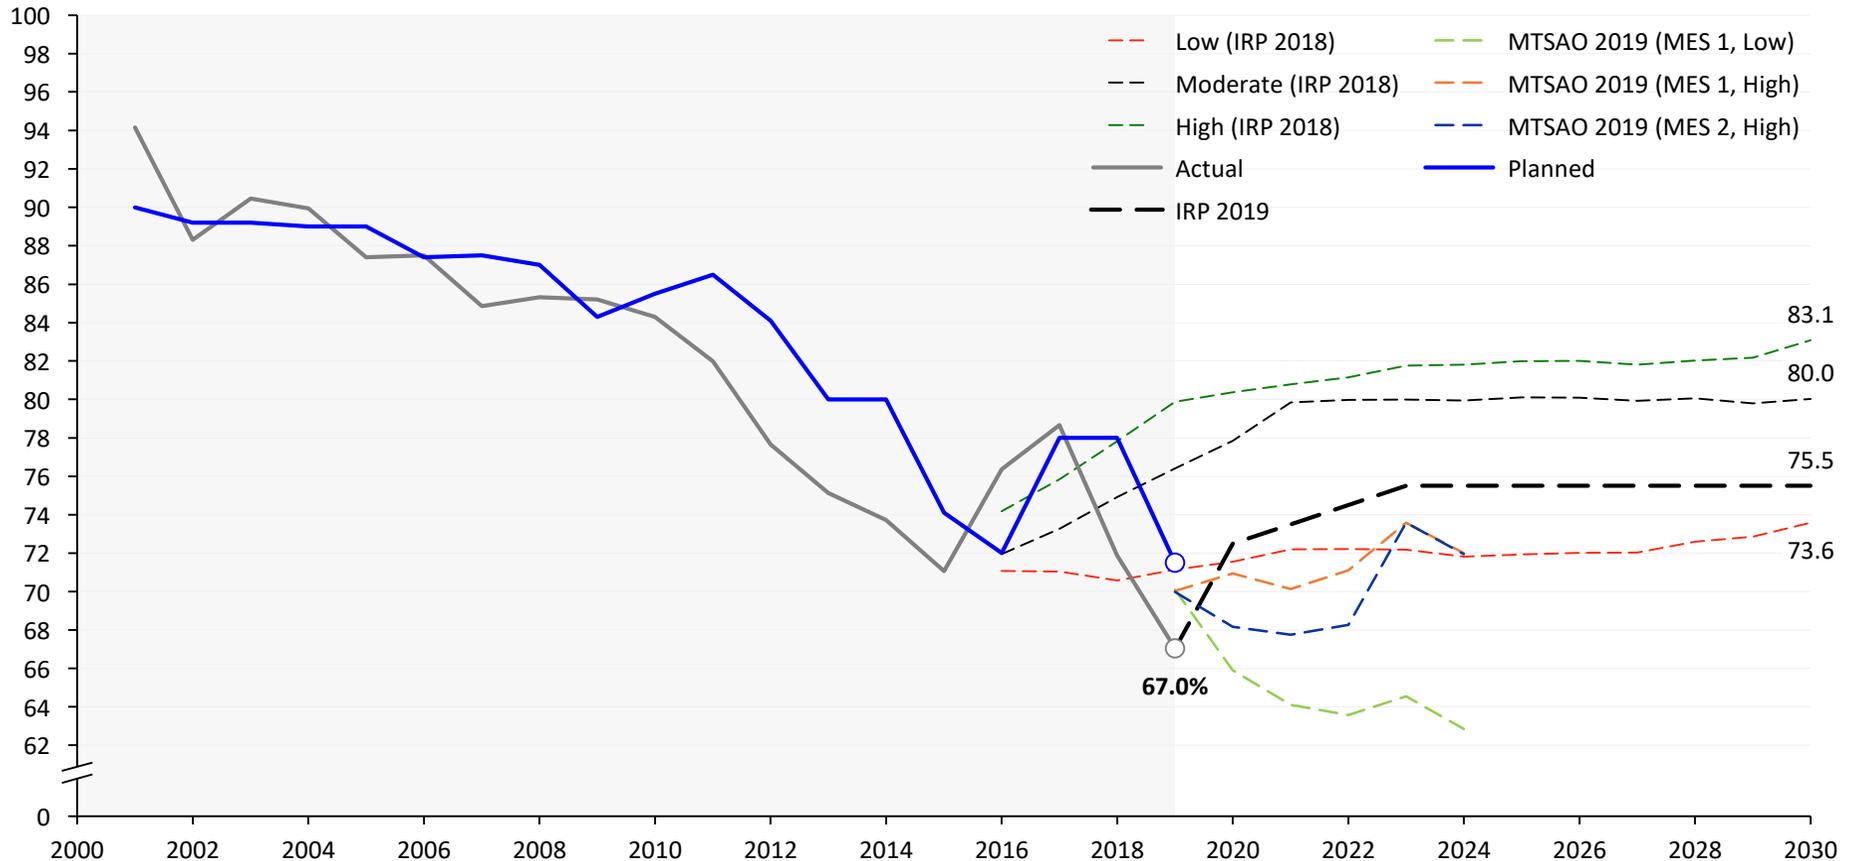


EAF – Energy Availability Factor; MTSAO – Medium-term System Adequacy Outlook


NOTE: 2019 EAF actual is YTD

Sources: Draft IRP 2018; IRP2019; Eskom; CSIR Energy Centre analysis


The supply-demand balance must be maintained for every hour of every day utilising available supply/demand options (dispatchable & self-dispatched)

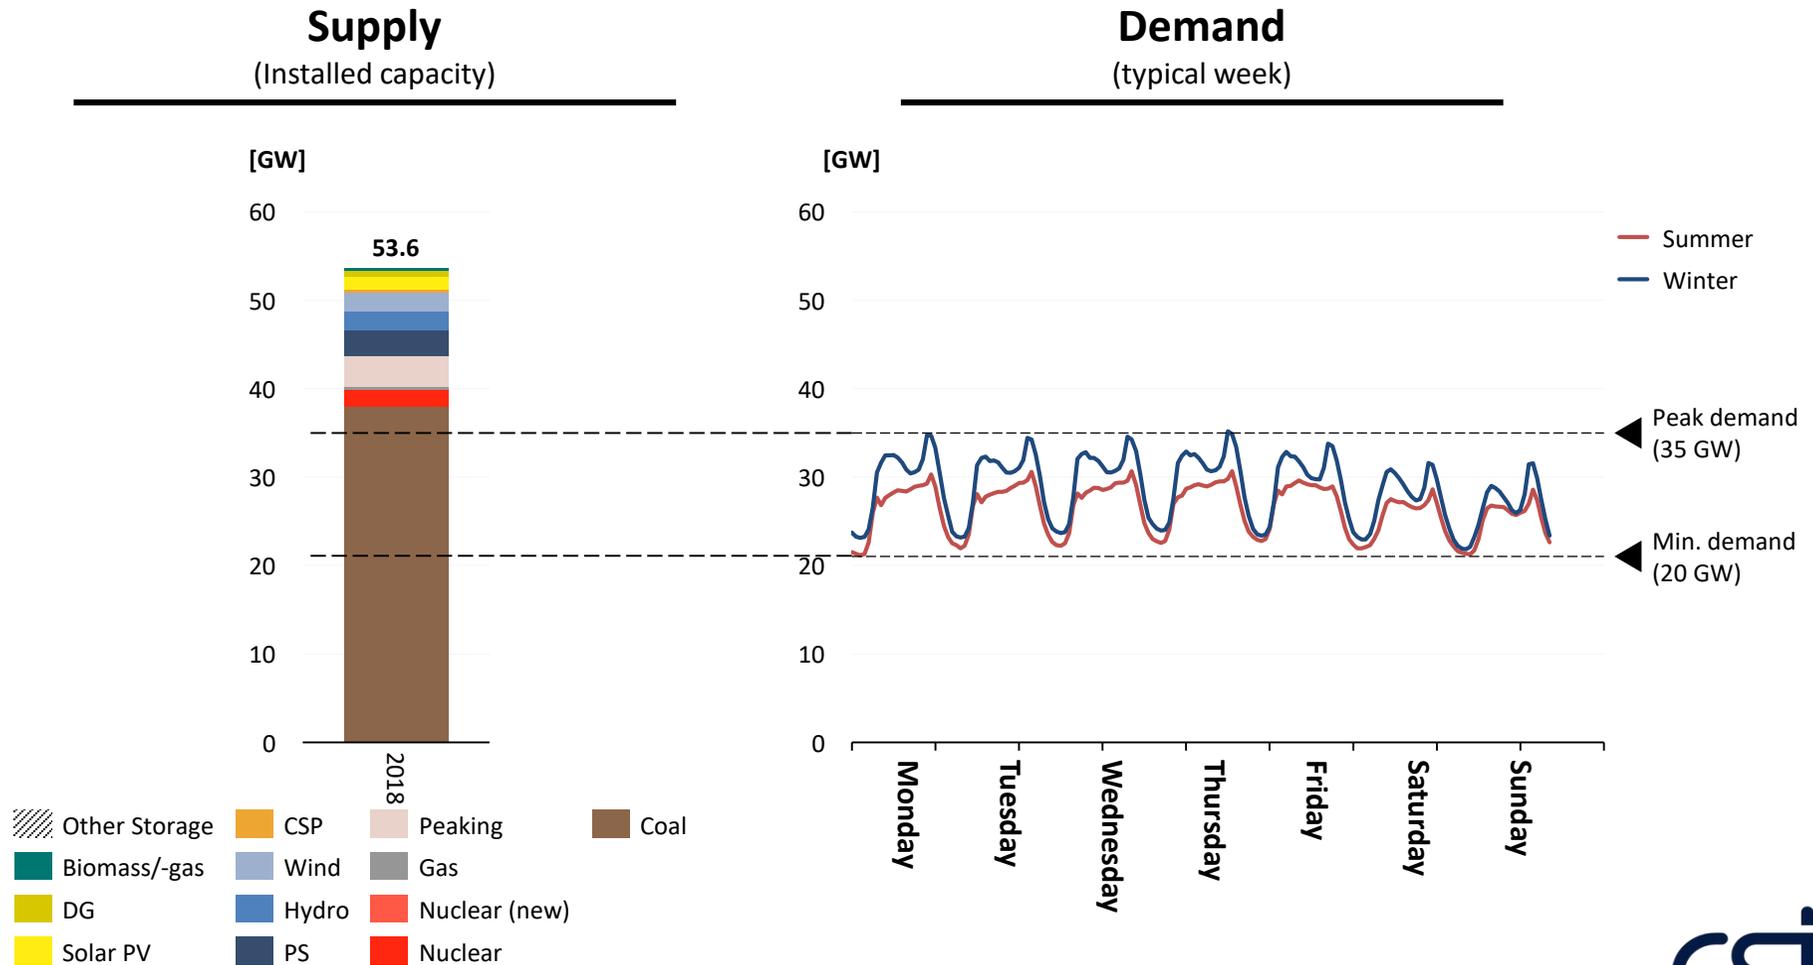

Example – Lower EAF (lower coal fleet availability) would mean a more constrained power system and high-risk of loadshedding

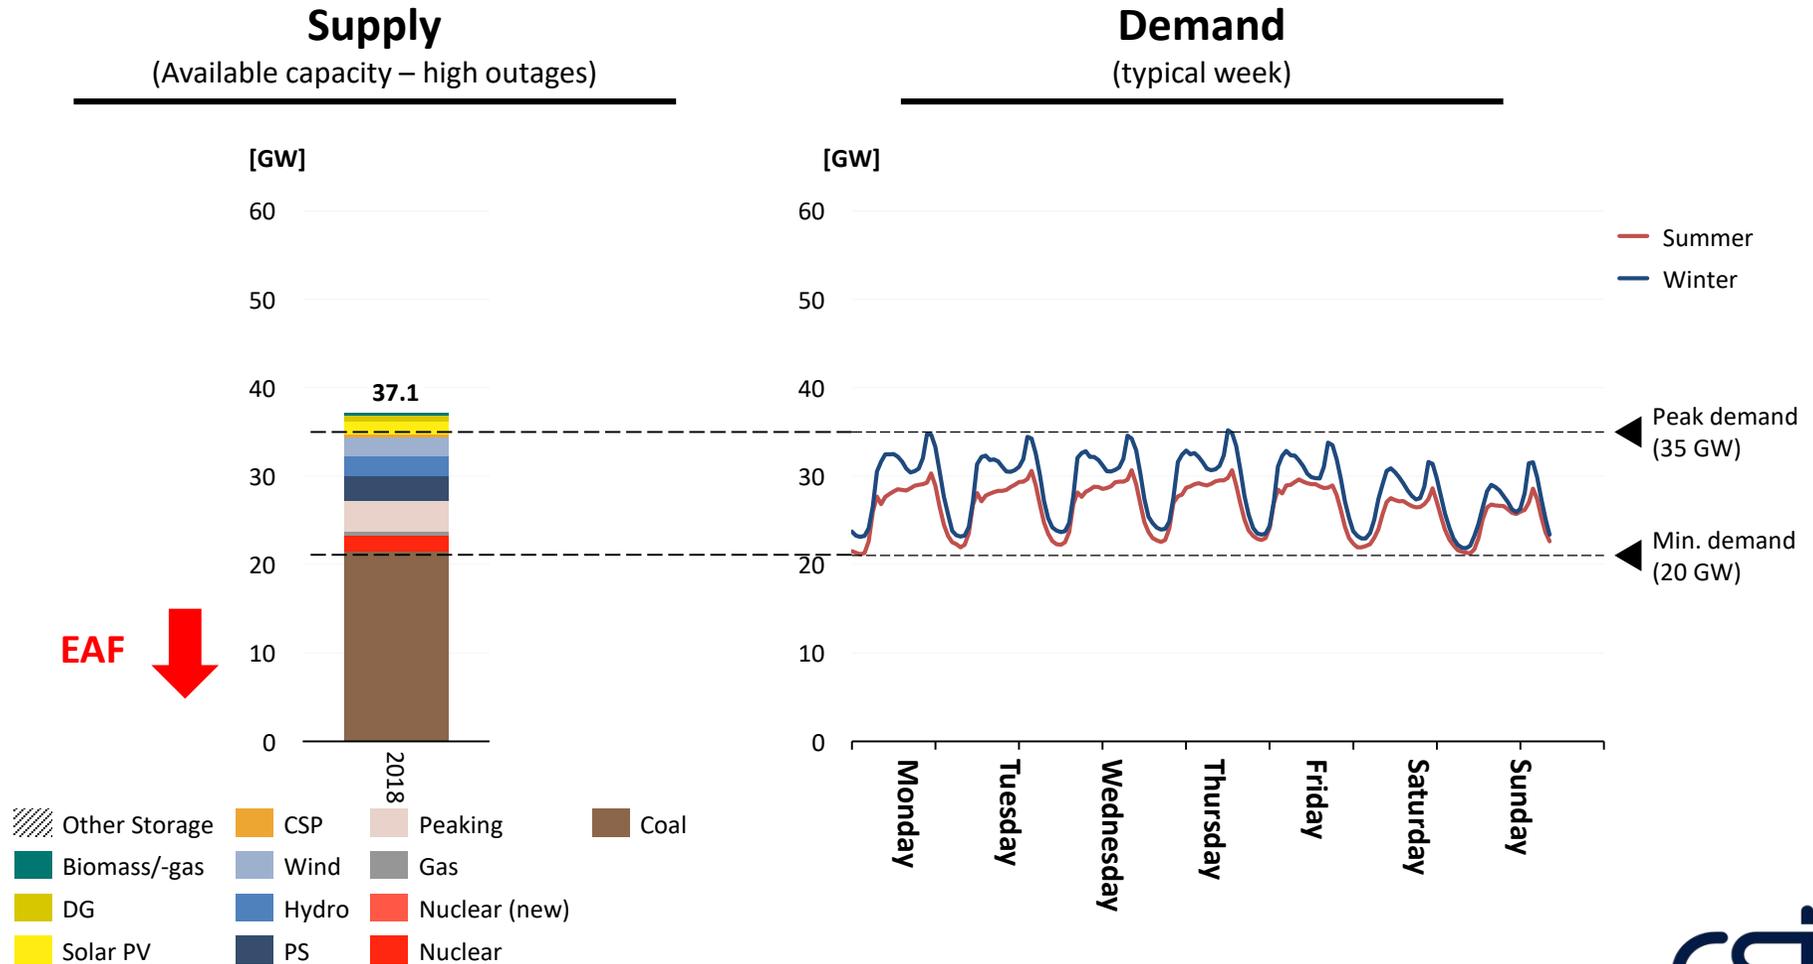

Example – Higher EAF (higher coal fleet availability) would mean a less constrained power system and low-risk of loadshedding

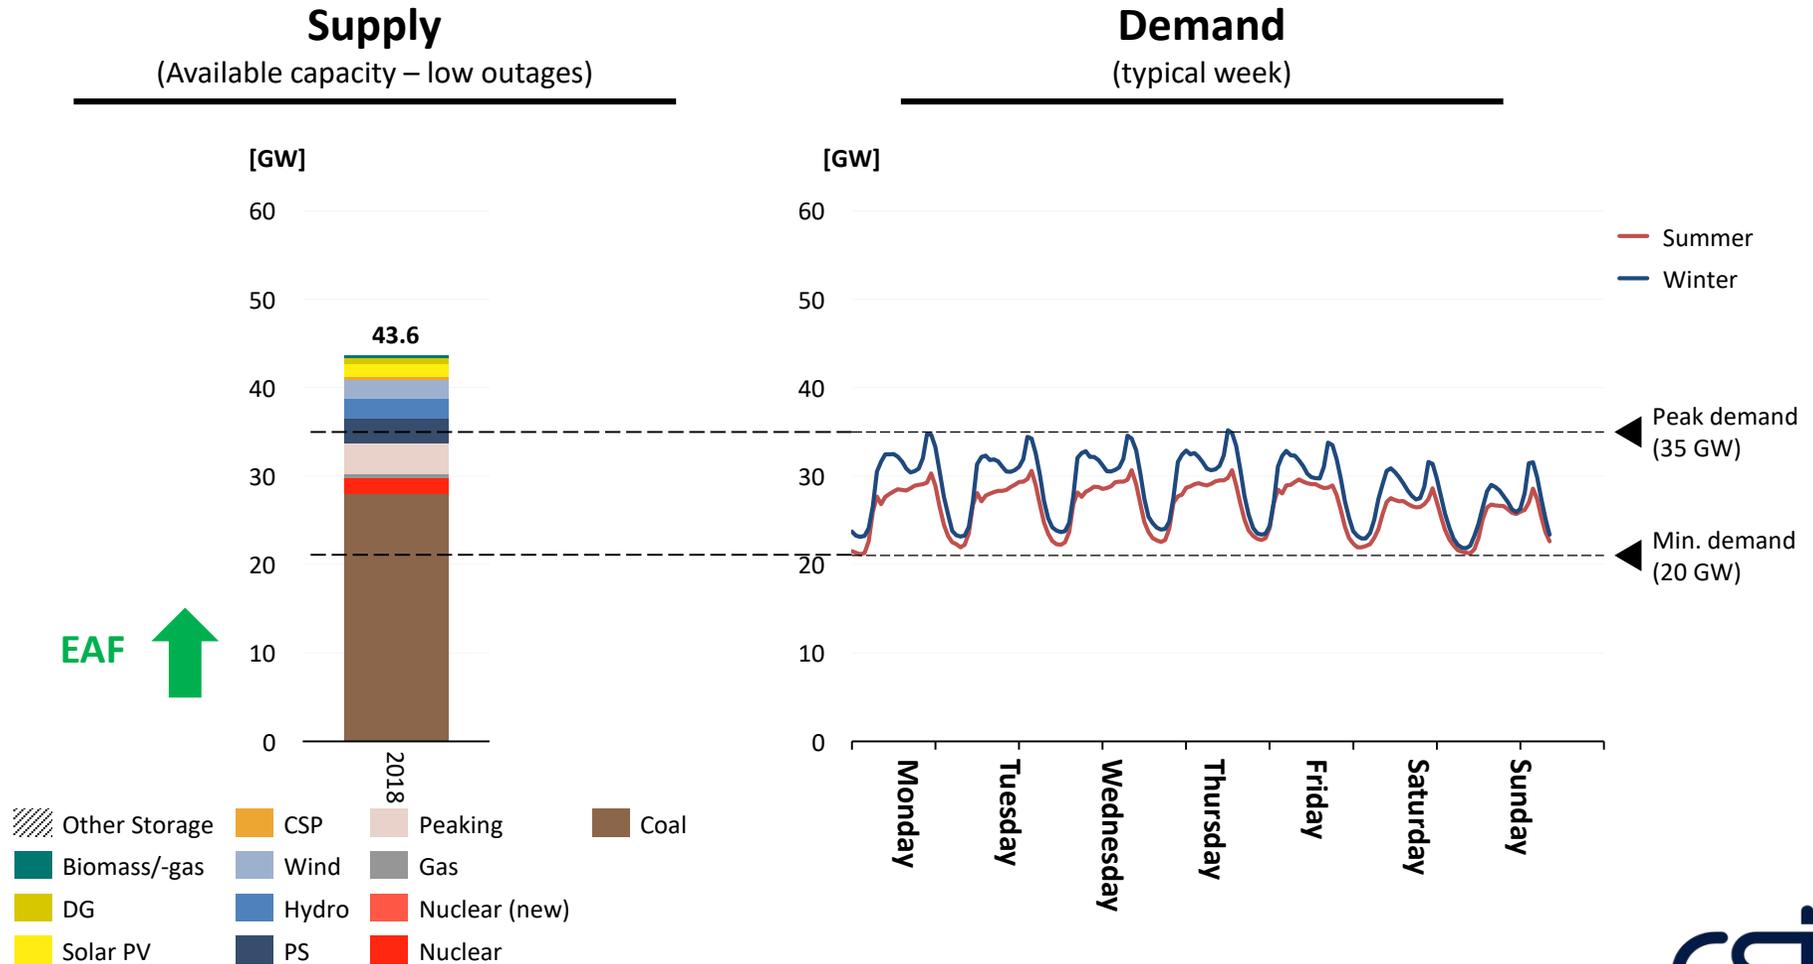

Agenda

1	Executive Summary	2
2	The burning platform	18
3	Current plans (IRP 2019)	30
4	What if?	39
5	Mitigation options/solutions	45


System inadequacy has been highlighted recently by DMRE and Eskom – but no specific solutions/interventions provided

Integrated Resource Plan 2019 (IRP 2019)

- Released: October 2019
- Highlighted short-term supply gap between 2019-2022
- Primarily due to lead-time of first new-build capacity in 2023


Medium-Term System Adequacy Outlook 2019 (MTSAO 2019)

- Released: November 2019
- Also highlighted lack of system adequacy if Eskom fleet EAF is below 72% for time horizon 2019-2024
- No new investments made in time-horizon

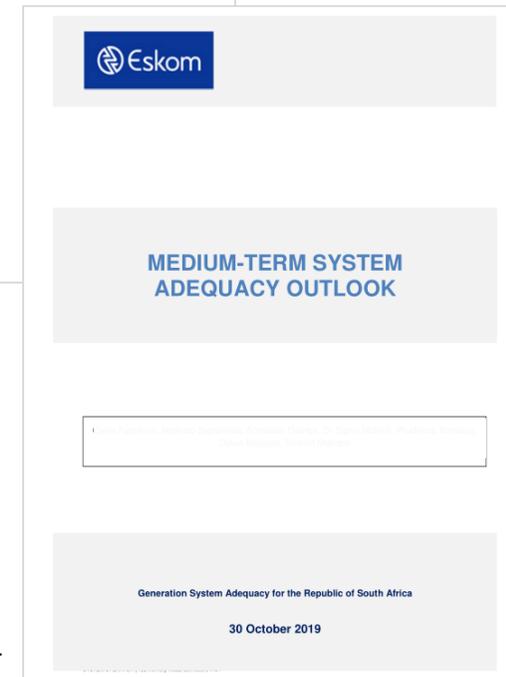

NOTE: Different assumptions made in a few dimensions for IRP 2019 and MTSAO 2019 (demand forecast, EAF, supply) but same conclusions reached.
Sources: DMRE; Eskom

CSIR simulated South African power system model benchmarked against actuals shows good alignment (2018 as a reference - annual)

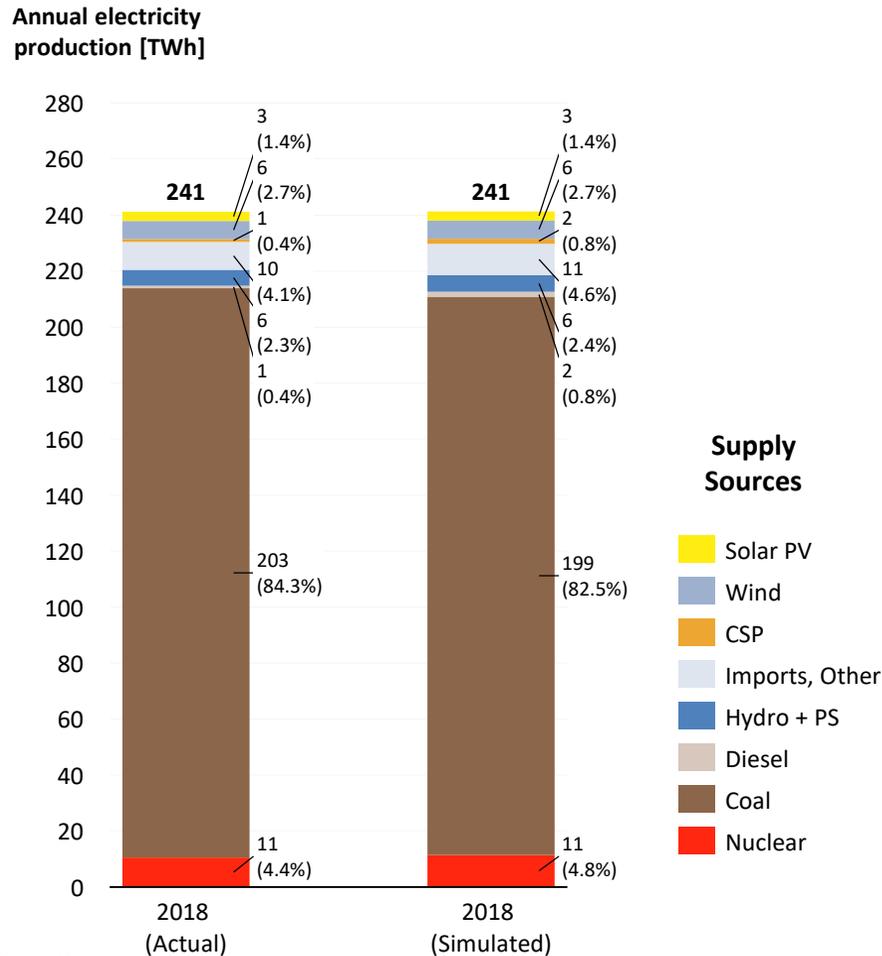


PS – Pumped Storage; HVDC – High Voltage Direct Current;

NOTES: Includes generation for pumping load; Simulation in PLEXOS: production cost model with hourly temporal resolution and public input data; "Imports, Other" includes mostly imported hydro generation (via HVDC imports from Mozambique);


Sources: Eskom; CSIR Energy Centre analysis

CSIR simulated South African power system model benchmarked against actuals shows good alignment – coal focus (2018 as a reference - monthly)

Monthly electricity production from Eskom coal in TWh

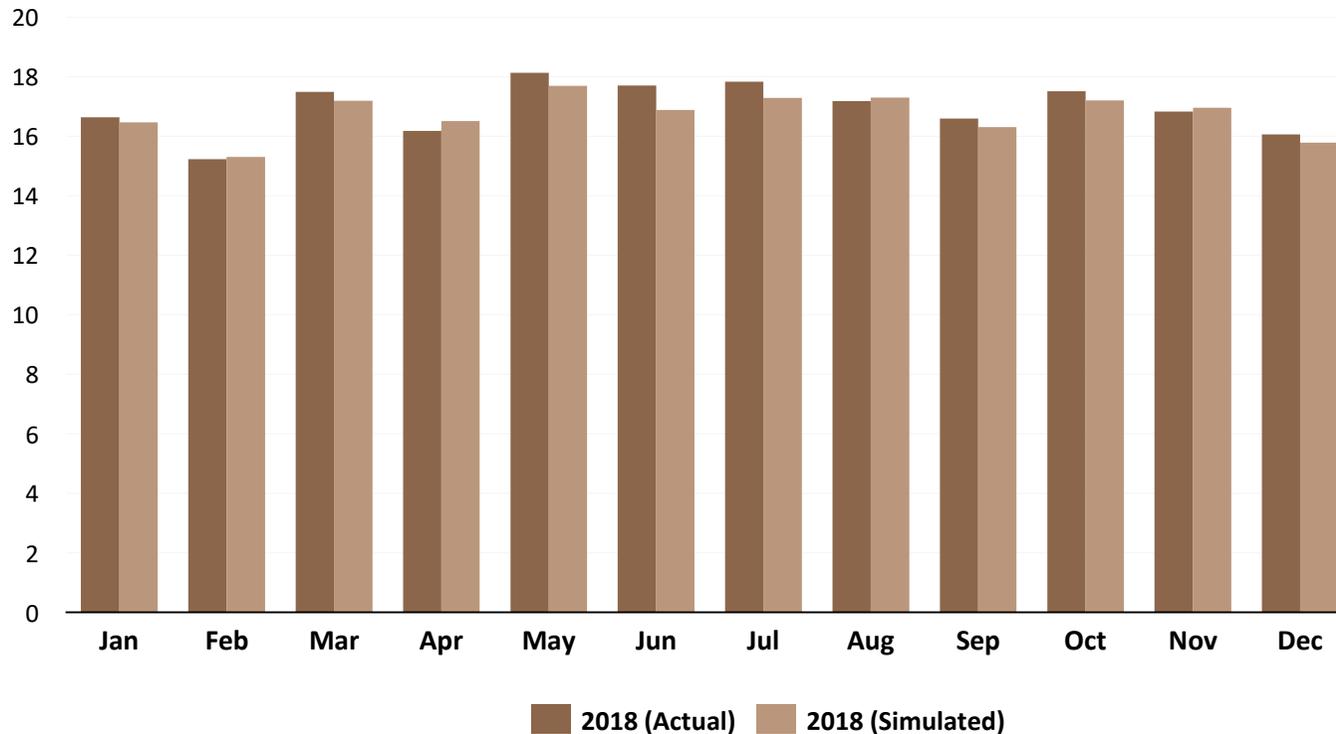

Annual electricity production in TWh

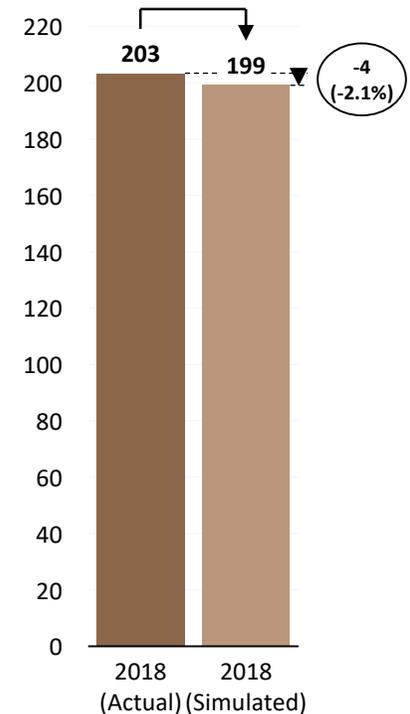

NOTES: Simulation in PLEXOS: production cost model with hourly temporal resolution and public input data;
Sources: Eskom; CSIR Energy Centre analysis

IRP 2019 has been gazetted indicating an immediately inclining demand forecast, decommissioning coal fleet but with improving EAF


Installed capacity and electricity supplied from 2018 to 2050

Installed capacity


Energy mix

IRP 2019 (DMRE)

Total installed capacity (net) [GW]

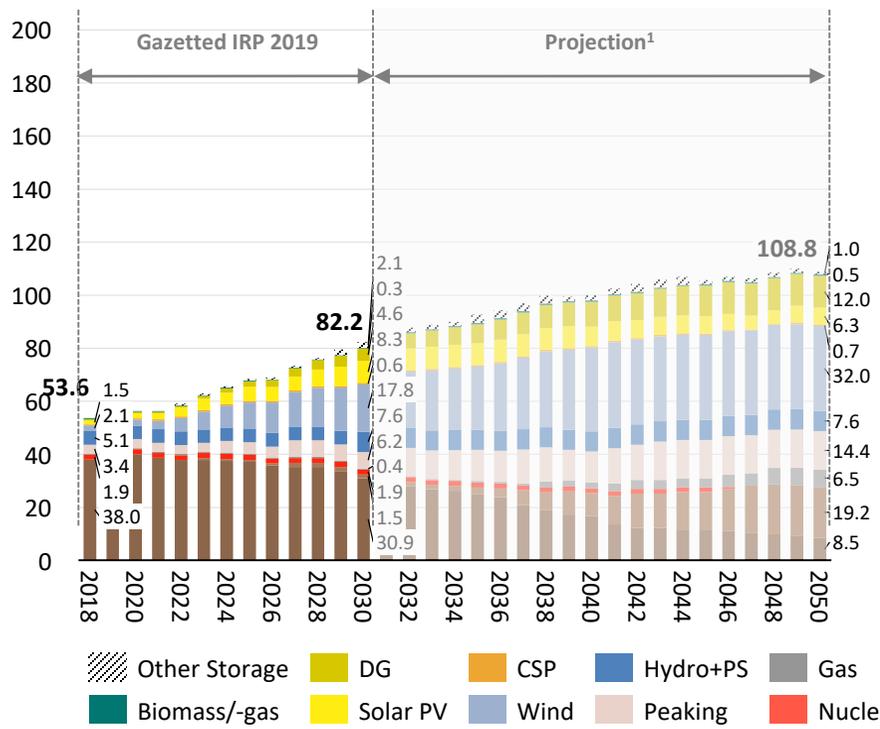

Electricity production [TWh/yr]

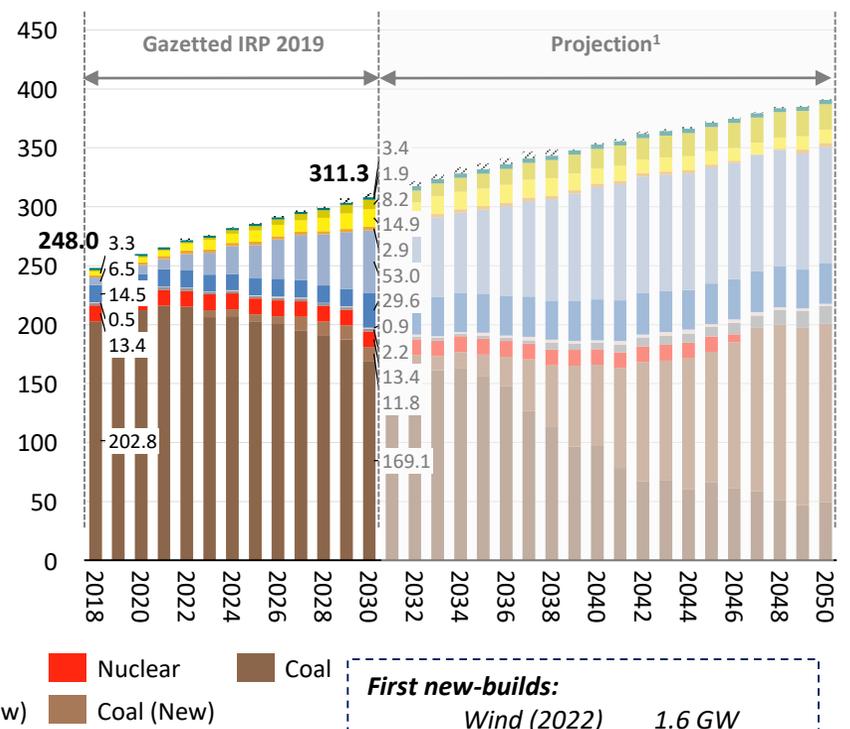

- Other Storage
- DG
- CSP
- Hydro+PS
- Gas
- Nuclear
- Coal
- Biomass/-gas
- Solar PV
- Wind
- Peaking
- Nuclear (new)
- Coal (New)

First new-builds:

Wind (2022)	1.6 GW
PV (2022)	1.0 GW
Storage (2022)	0.5 GW
Coal (2023)	0.75 GW
Gas (2024)	1.0 GW

¹ Projection based on optimisation of 2030-2050 energy mix utilising input assumptions from DMRE IRP 2019 (not unconstrained least-cost);
 DSR – Demand Side Response; DG = Distributed Generation; VRE – variable renewable energy;
 NOTE: Energy share is a best estimate based on available data.
 Sources: IRP 2019. CSIR Energy Centre analysis

IRP 2019 has also indicated an expected gap between 2018-2022 following which expected new-build options can come online (lead time dependant)


Installed capacity and electricity supplied from 2018 to 2050

Installed capacity


Energy mix

IRP 2019
(DMRE)

Total installed capacity (net) [GW]

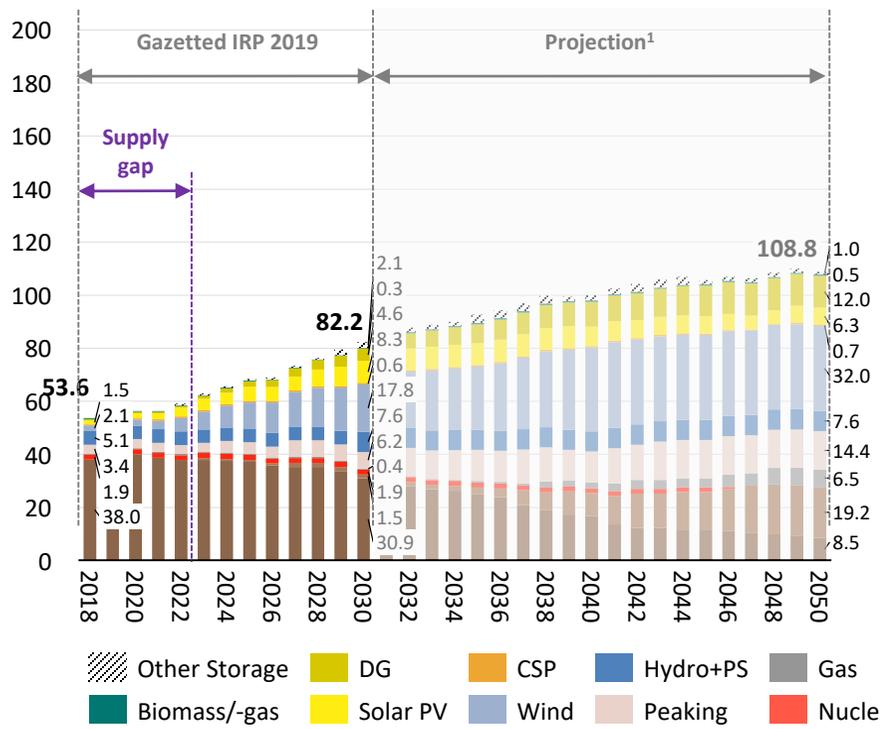

Electricity production [TWh/yr]

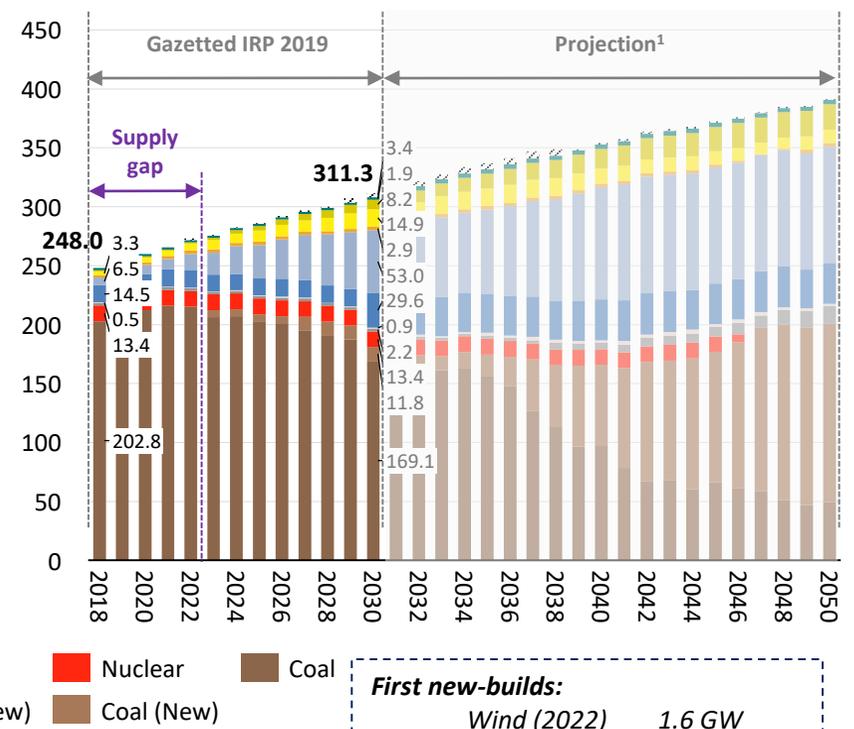


First new-builds:

Wind (2022)	1.6 GW
PV (2022)	1.0 GW
Storage (2022)	0.5 GW
Coal (2023)	0.75 GW
Gas (2024)	1.0 GW


¹ Projection based on optimisation of 2030-2050 energy mix utilising input assumptions from DMRE IRP 2019 (not unconstrained least-cost); DSR – Demand Side Response; DG = Distributed Generation; VRE – variable renewable energy; NOTE: Energy share is a best estimate based on available data. Sources: IRP 2019. CSIR Energy Centre analysis

Shortage from IRP 2019 indicating a dominant short-term capacity gap & small energy gap until planned new-build capacity comes online

Capacity (shortage)

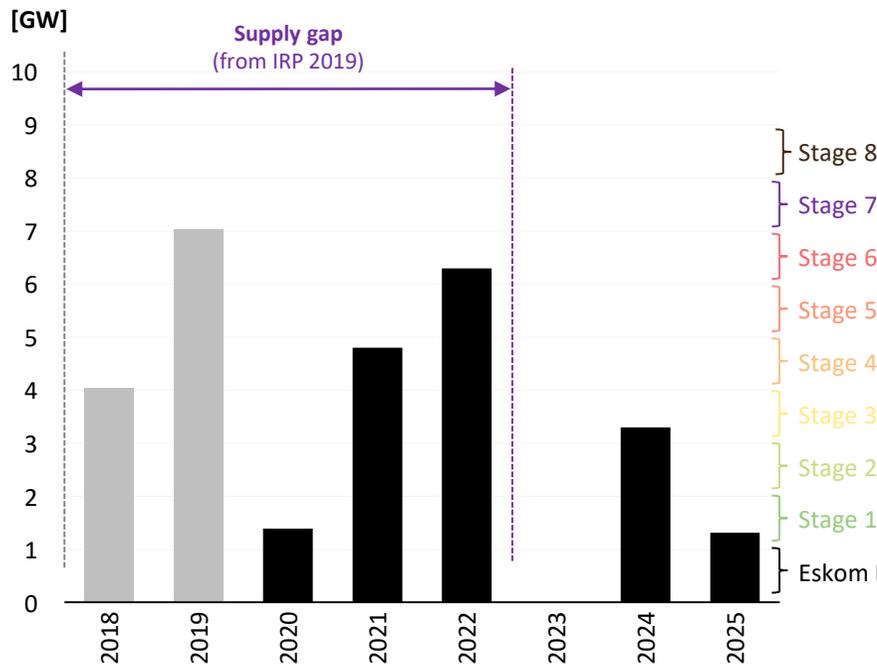

Energy (shortage)

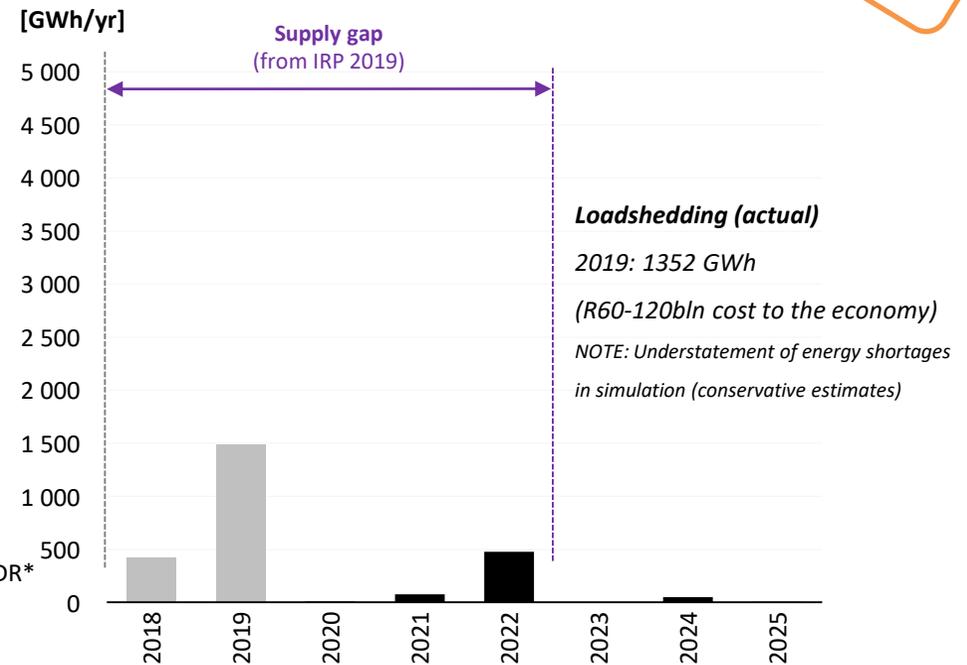


IRP 2019 (DMRE)

IRP 2019 EAF & IRP 2019 demand forecast

(EAF recovery from ≈67% in 2019 to 75.5% by 2024) (Demand forecast immediately growing to 284 TWh by 2025)

* Estimated Eskom Demand Response (DR) capability (mostly industrial & energy limited); NOTES: Energy & capacity shortage is demand that cannot be served due to a lack of capacity (including OCGTs, pumped storage & Eskom DR); Outcomes shown are from deterministic simulations - thus indicative; 99th percentile of capacity & energy shortage is reported; All IRP 2019 capacity is assumed to come online as planned (Step 3 is always considered implemented); Cost of load shedding is estimated using COUE (cost of unserved energy) = 87.50 R/kWh; Sources: CSIR Energy Centre analysis

IRP 2019 daily shortage profile shows capacity need in the morning/evening peak combined with daytime energy needs

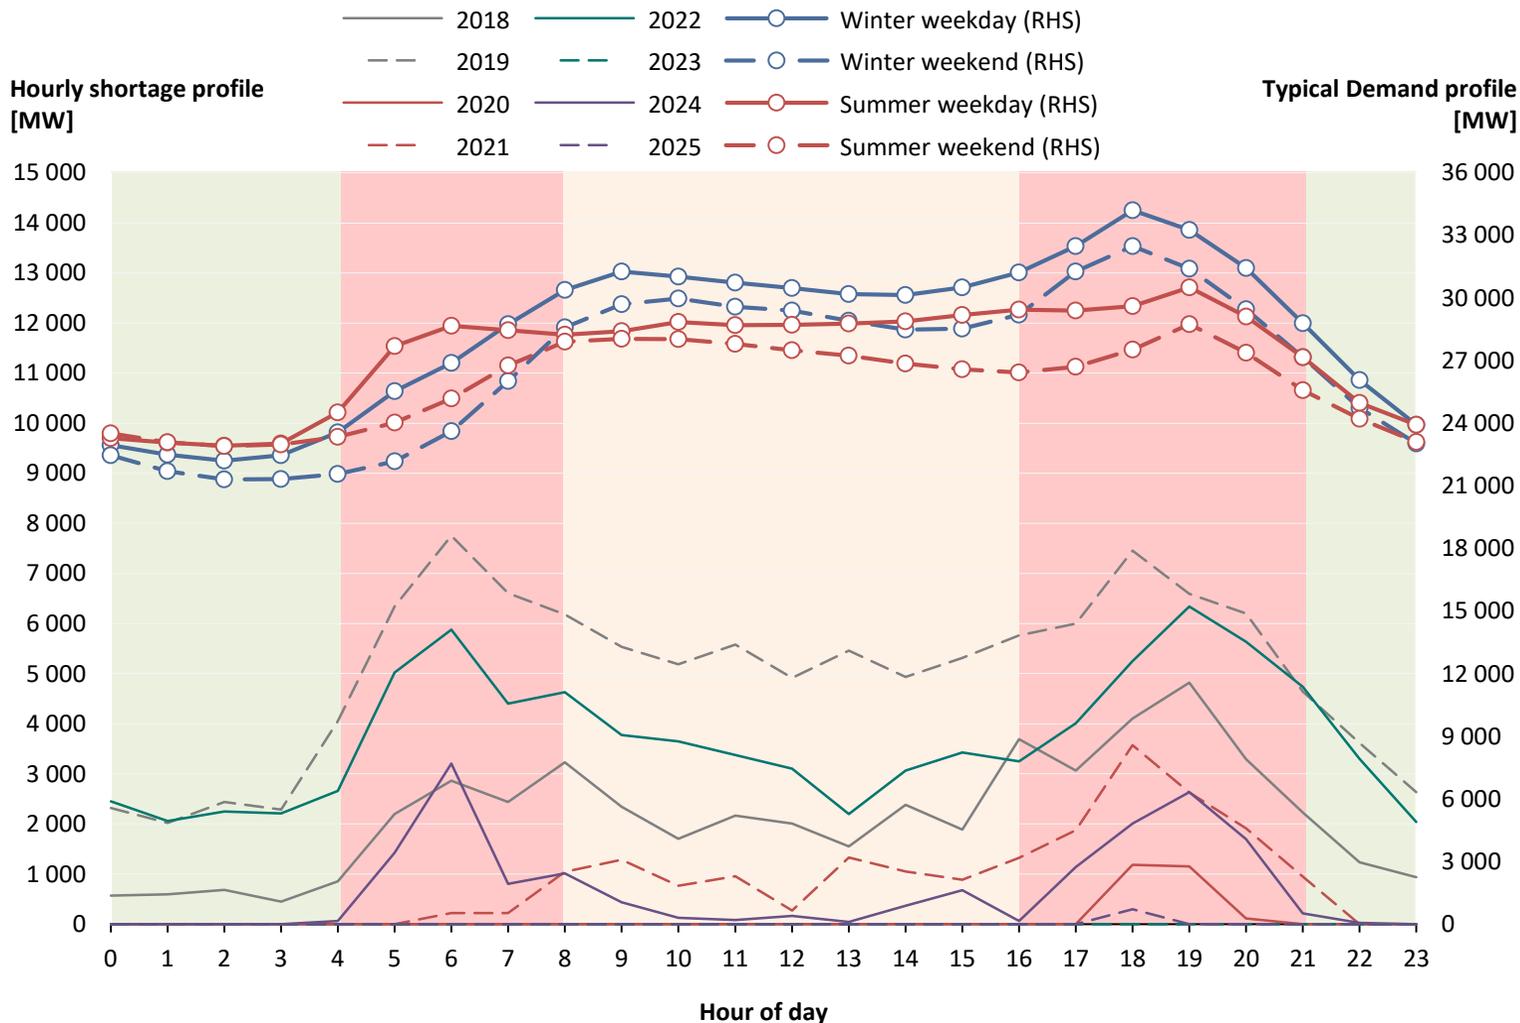


IRP 2019
(DMRE)

NOTE: Energy & capacity shortage is demand that cannot be served due to a lack of capacity (including OCGTs, pumped storage & Eskom DR); Outcomes shown are from deterministic simulations - thus indicative; 99th percentile of capacity & energy shortage is reported.

Sources: CSIR Energy Centre analysis

Representative 2 weeks - constrained/unconstrained showing capacity needs along with daytime energy needs during some weekdays

Simulated hourly generation stack of the total power supply in RSA for 2 weeks in April 2021

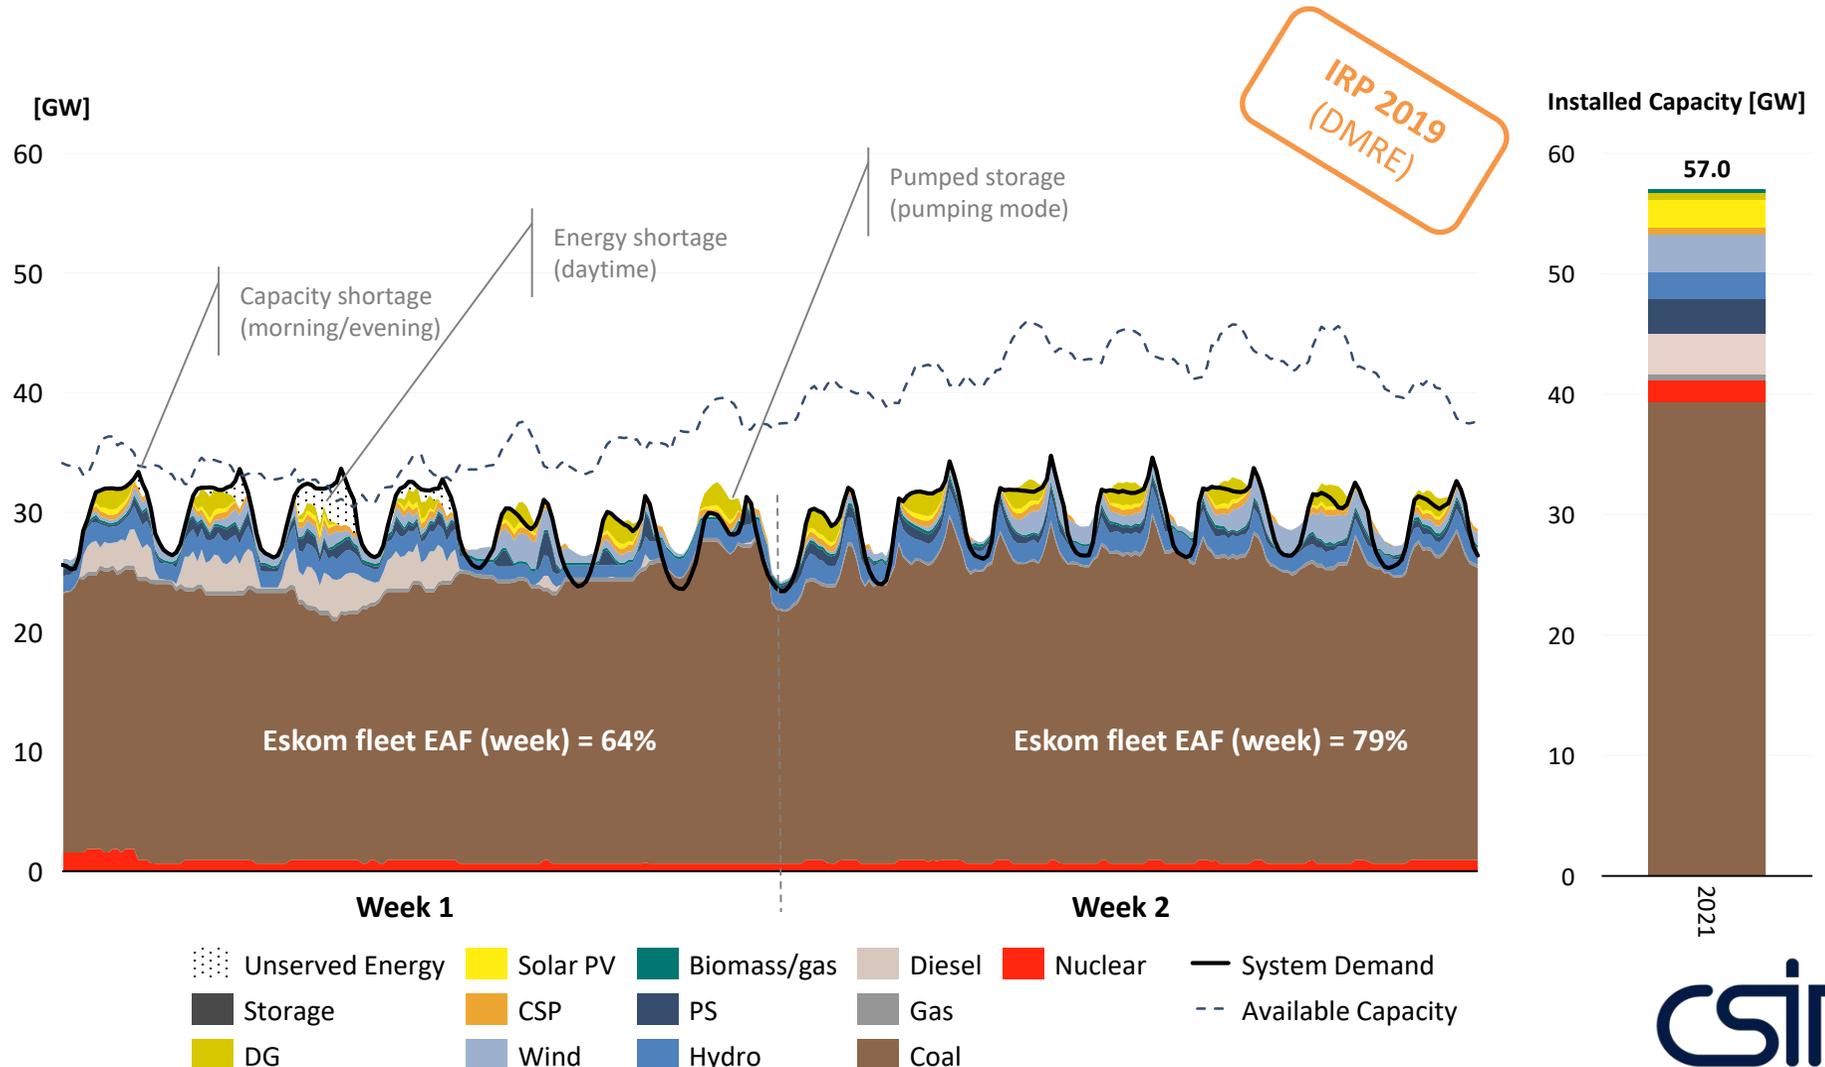


NOTE: Representative week(s) shown but entire time horizon is simulated at hourly resolution in production cost model applying unit commitment and economic dispatch principles; Sources: CSIR Energy Centre analysis

Agenda

1	Executive Summary	2
2	The burning platform	18
3	Current plans (IRP 2019)	30
4	What if?	39
5	Mitigation options/solutions	45

What if the demand forecast is lower than in IRP 2019 (very likely) and what if the Eskom fleet EAF is lower than in IRP 2019 (also very likely)?

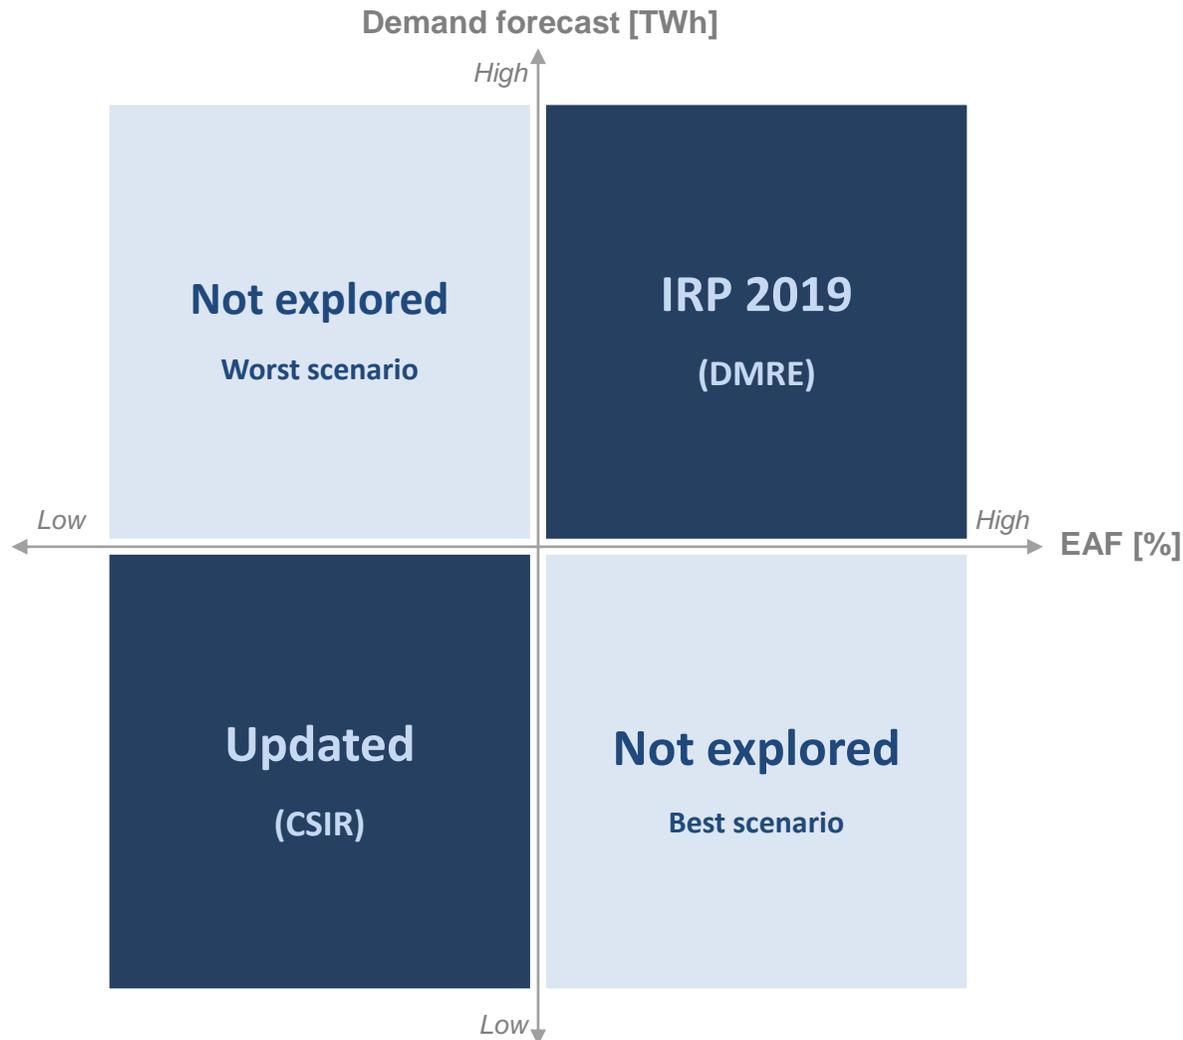


Sources: CSIR Energy Centre analysis

Would an updated EAF expectation and demand forecast make any difference to capacity and energy shortages?


EAF

Energy Availability Factor (EAF)
[%]

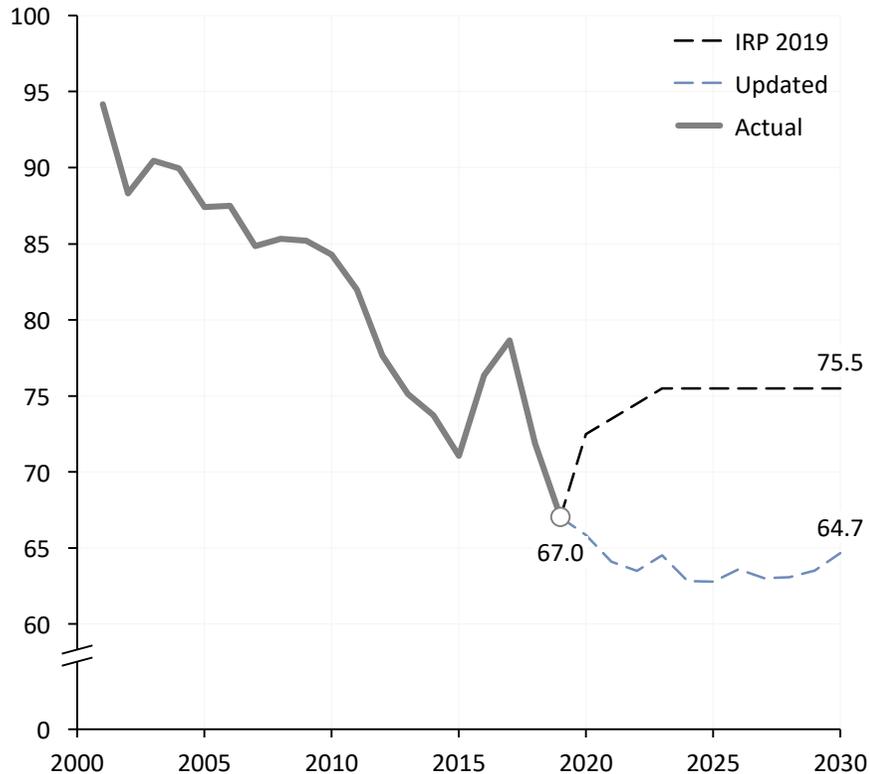

Demand forecast

Electrical energy demand
[TWh]

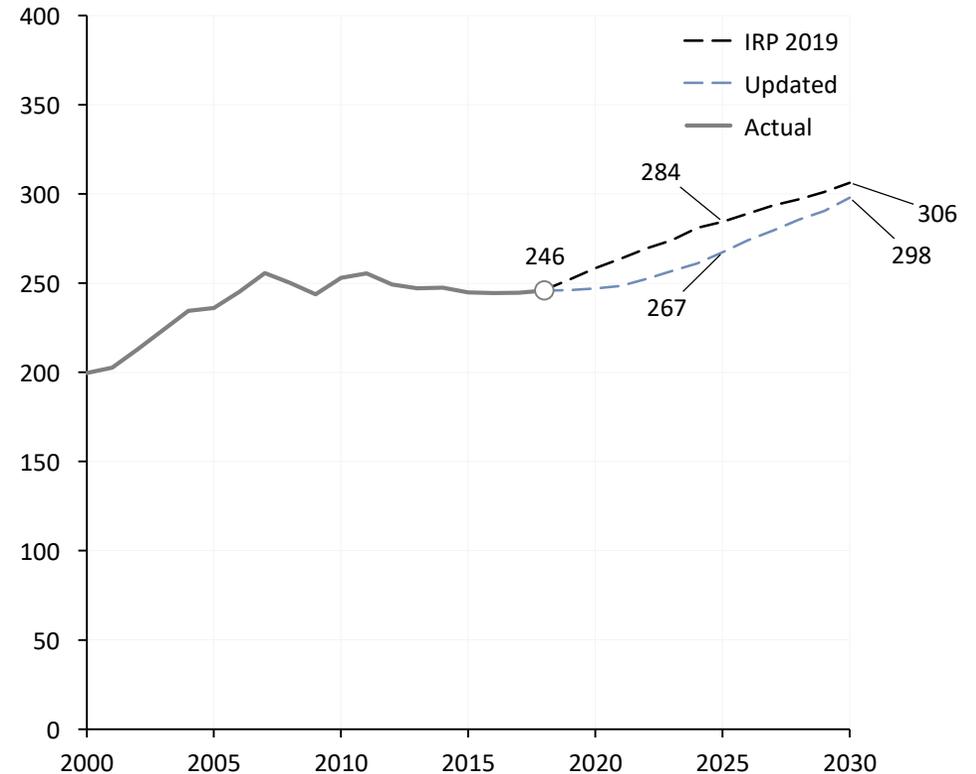


NOTE: "Updated" scenario is a test scenario developed by CSIR; Demand forecast is based on Eskom MTSAO demand forecast (until 2024) and IRP 2019 growth rates thereafter; Updated EAF based on MTSAO MES 1 (Low); EAF – Energy Availability Factor

Sources: IRP 2019; MTSAO; CSIR


Updated EAF & demand forecast indicates further shortage relative to IRP 2019 requiring capacity and significantly more energy

Updated (CSIR)

Capacity (shortage)

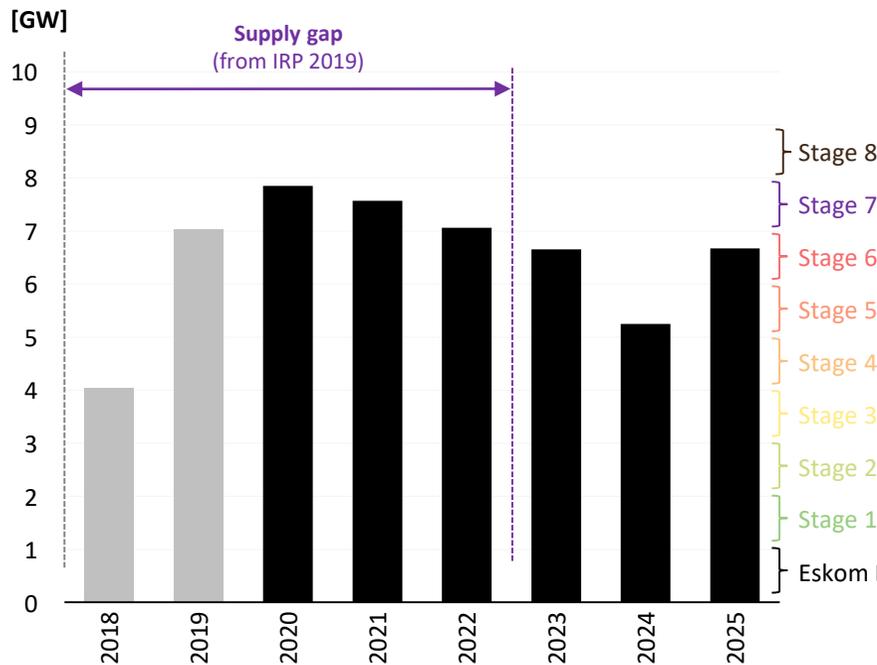

Energy (shortage)

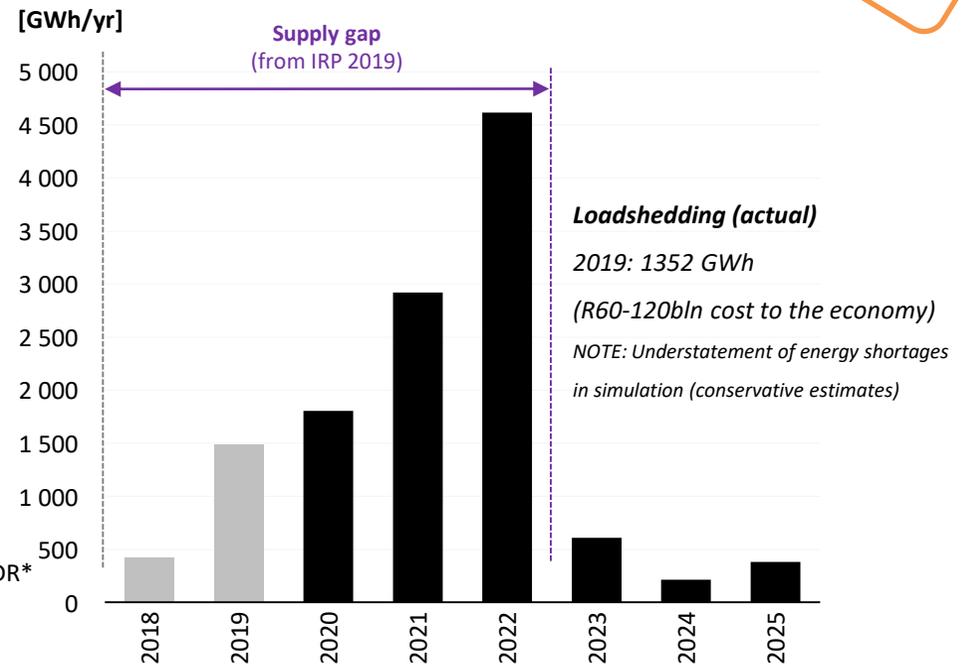


Updated EAF & Updated demand forecast

(EAF from ≈67% in 2019 to ≈64% by 2024) (Demand forecast initially flat & growth to 267 TWh by 2025)

* Estimated Eskom Demand Response (DR) capability (mostly industrial & energy limited); NOTES: Energy & capacity shortage is demand that cannot be served due to a lack of capacity (including OCGTs, pumped storage & Eskom DR); Outcomes shown are from deterministic simulations - thus indicative; 99th percentile of capacity & energy shortage is reported; All IRP 2019 capacity is assumed to come online as planned (Step 3 is always considered implemented); Cost of load shedding is estimated using COUE (cost of unserved energy) = 87.50 R/kWh; Sources: CSIR Energy Centre analysis

Updated scenario shows initial morning/evening capacity need combined with all-day energy, shifting to morning/evening need only in later years

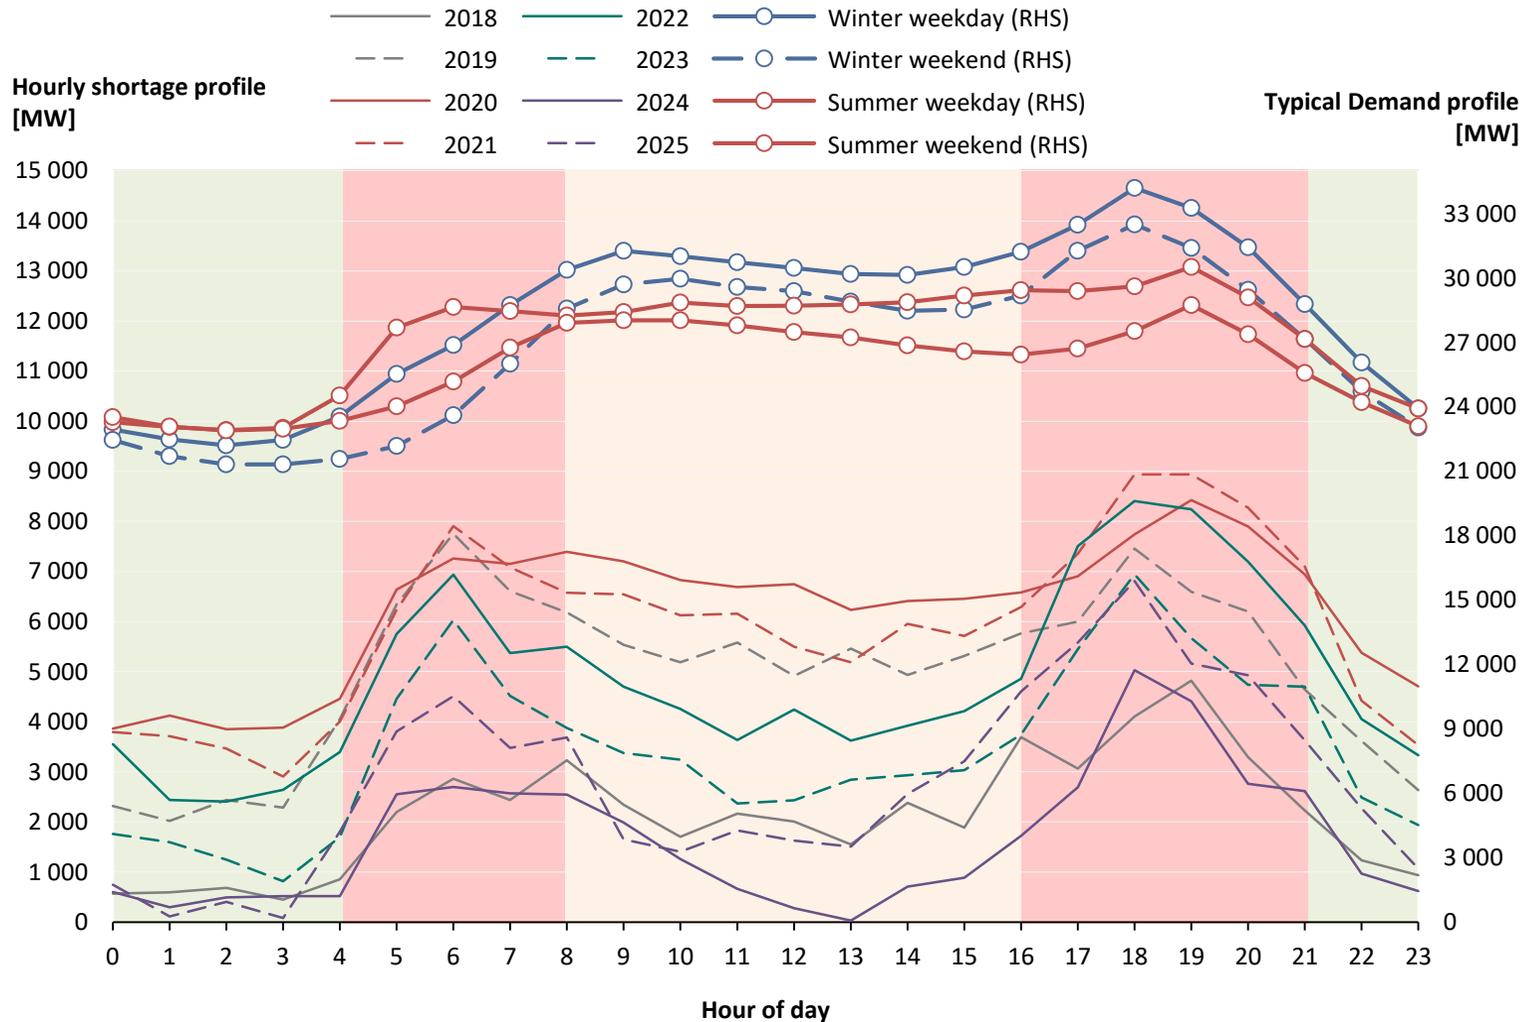


Updated (CSIR)

NOTE: Energy & capacity shortage is demand that cannot be served due to a lack of capacity (including OCGTs, pumped storage & Eskom DR); Outcomes shown are from deterministic simulations - thus indicative; 99th percentile of capacity & energy shortage is reported.
Sources: CSIR Energy Centre analysis

Example – Updated scenario showing significant capacity & energy shortages during representative 2 weeks

Simulated hourly generation of the total power supply in RSA for 2 weeks in May 2021

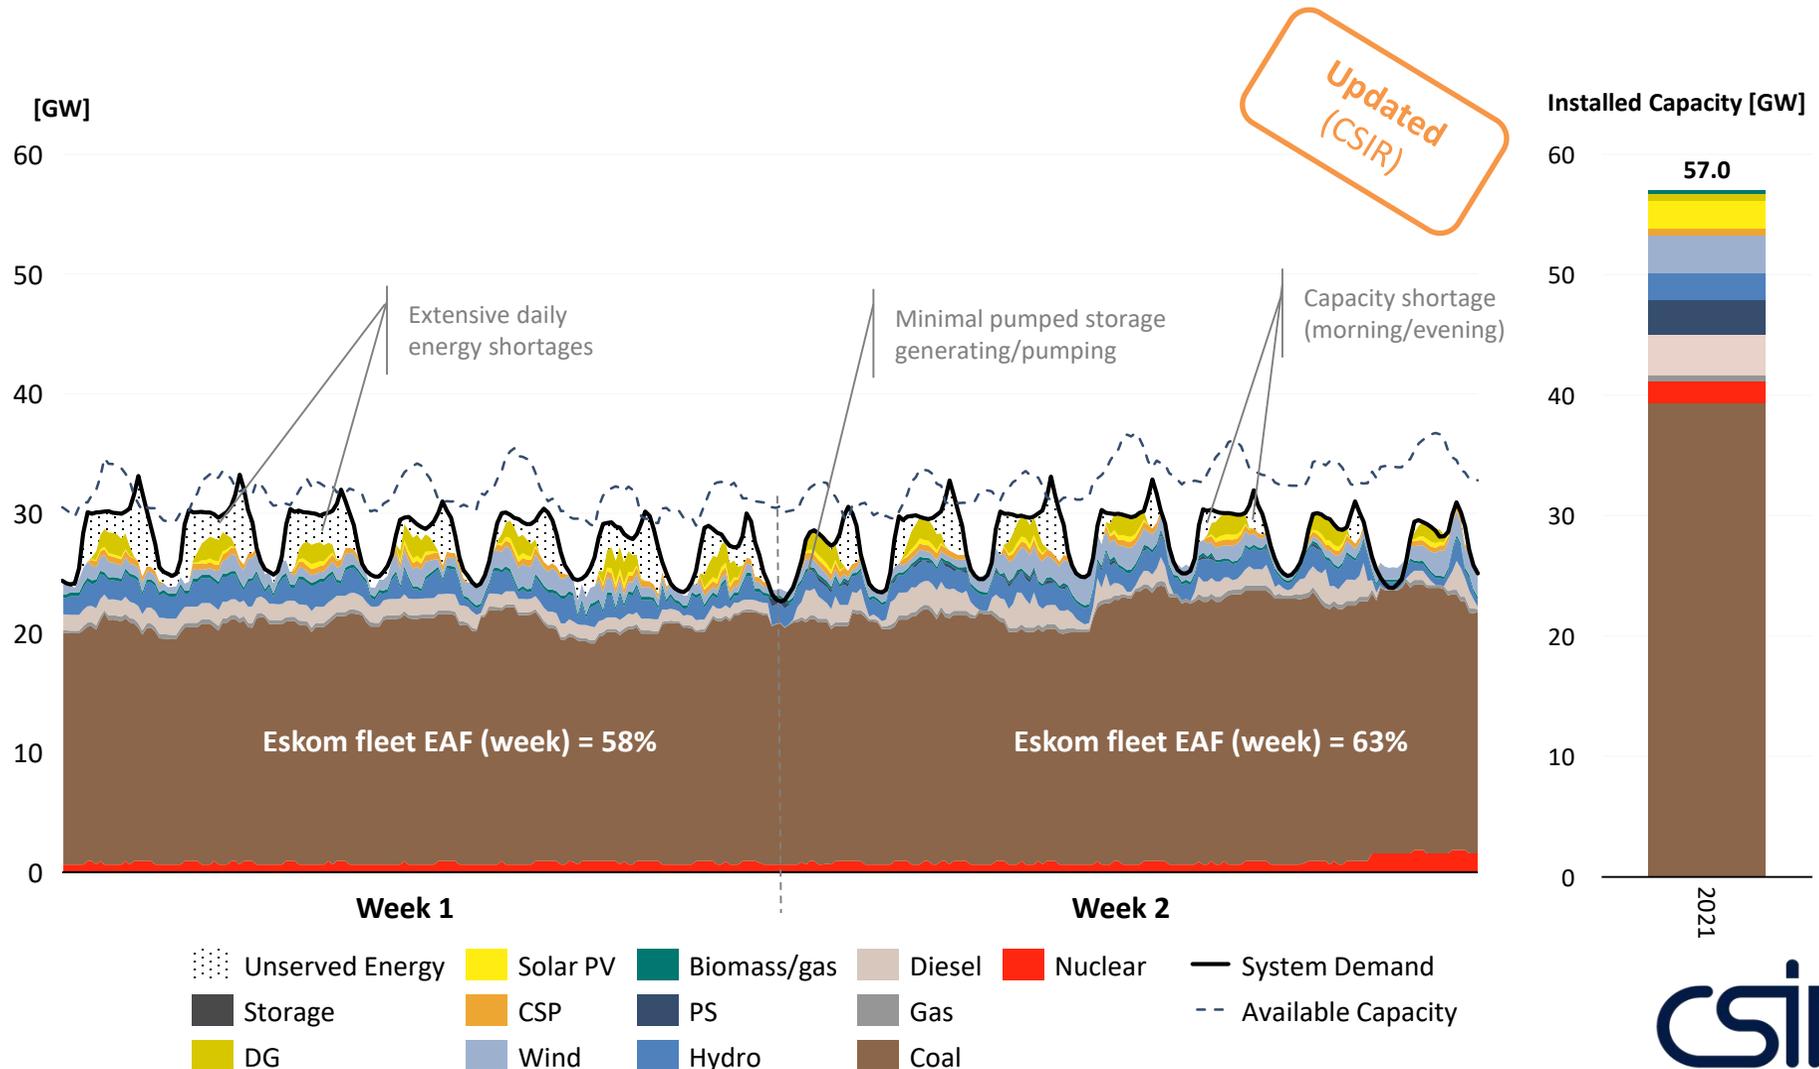

NOTE: Representative week(s) shown but entire time horizon is simulated at hourly resolution in production cost model applying unit commitment and economic dispatch principles;
Sources: CSIR Energy Centre analysis

Agenda

1	Executive Summary	2
2	The burning platform	18
3	Current plans (IRP 2019)	30
4	What if?	39
5	Mitigation options/solutions	45

Criteria to decide on options to meet the short-term gap should be informed and applied consistently to ensure reasonable cost and timeous delivery

Criteria for choice of short-term options available can ensure a portfolio of options:

- 1 Can be supply-side, demand-side and/or storage
- 2 Can be delivered in 1-2 years
- 3 Will not require extensive procurement process (lead-time)
- 4 Can meet capacity (MW) and/or energy needs (MWh)
- 5 Can be contracted for 1-3 years (or more if aligned with long-term energy mix)
- 6 Ease of implementation (does not require extensive regulatory reform/change)
- 7 Aligned with long-term energy mix pathways (technology choices)
- 8 Does not require extensive network expansion or augmentation for interconnection

Choice of the suite of solutions/interventions to fill the gap is highly dependant on lead-times and limits resulting options available

Supply-side options	Technical potential ⁵	Short-term (2020-2022)	REIPPPP 'power-up' 200-500 MW (2020) SSEG ¹ (com./ind./agri.) 400-750 MW/yr	SSEG ² (res.) 125-200 MW/yr DG/EG ³ (ind./min.) 250-750 MW/yr	Standby Gx aggregator 200-1 000 MW/yr Emergency Gx ⁴ 500-2 000 MW/yr
	Prescribed in IRP 2019	Medium-term/Long-term (≥2023)	IRP 2019 (first new-build): Wind: 1 600 MW (2022) Solar PV: 1 000 MW (2022) Coal: 750 MW (2023) EG/DG: 500 MW (2023) Gas: 1 000 MW (2024)	IRP 2019 (by 2030) Wind: 14 400 MW Solar PV: 6 000 MW Coal: 1 500 MW EG/DG: 4 000 MW Gas: 3 000 MW	
Demand-side options	Technical potential ⁵	Short-term (2020-2022)	Storage - SSEG ² (res.) 30-100 MW/yr / 90-300 MWh Storage - SSEG ¹ (com./ind./agri.) 100-375 MW/yr / 300-1125 MWh	Storage (munics) 30-120 MW/yr / 90-360 MWh DSR 50-300 MW/yr	Structural loadshedding Stage 1: 1 000 MW Stage 2: 2 000 MW
	Prescribed in IRP 2019	Medium-term/Long-term (≥2023)	IRP 2019 (first new-build): Storage: 513 MW (2022)	IRP 2019 (by 2030) Storage: 2 088 MW	

NOTES: Storage deployment is considered as a demand-side option for simplicity and ease of understanding (is a net user of energy); SSEG could include a range of technologies but would be dominated by solar PV; Gx – Generation; com. – Commercial; ind. – Industrial; min. – mining; agri. – Agricultural; res. – Residential; DSR – Demand Side Response; ¹ Requires adjusted SSEG regulations (proposed lifting licensing requirement for SSEG & only requiring registration with NERSA - from 1 MW to 10 MW (or more)); ² Does not require regulatory changes (just communications rollout but could be further incentivised by Eskom/municipalities); ³ Will require Ministerial Determination - generators expected to be >10 MW (technologies should be aligned with IRP 2019); ⁴ Will require fast-tracked procurement process; ⁵ In addition to capacity under construction.

Considering the options available – a customer response at scale would form the only options with fastest lead-times (likely mostly self-dispatched)

Step 1 (customer response at scale)

- Some solutions can be quickly implemented by customers & at scale (short lead-times)
- Immediate requirement is adjusted SSEG regulations
- Adjusted PPAs with already existing REIPPPP generation capacity
- Communications/incentives/financing for SSEG for further deployment (with requisite Eskom/municipal tariffs)
- DG/EG (ind./min.) expected to be >10 MW each, requires licensing & ministerial approval*
- Options include (from 2020 onwards):
 - REIPPPP ‘power-up’: 200-500 MW
 - SSEG (com./ind./agri.)¹: 400-750 MW/yr
 - Storage - SSEG (com./ind./agri.)¹: 100-375 MW/yr / 300-1125 MWh
 - SSEG (res.)²: 125-200 MW/yr
 - Storage - SSEG (res.)²: 30-100 MW/yr / 90-300 MWh
 - DG/EG (ind./min.)³: 250-750 MW/yr
 - Storage (munics)^{2,3}: 30-120 MW / 90-360 MWh
 - Structural loadshedding: Stage 1: 1000 MW; Stage 2: 2000 MW; (or more)

NOTES: Gx – Generation; com. – Commercial; ind. – Industrial; min. – mining; agri. – Agricultural; res. – Residential; DSR – Demand Side Response; * Technologies should be aligned with IRP 2019; DSR (EWHs) could also contribute 50-150 MW/yr in the short-term but has not been explicitly considered as yet due to uncertainty; ¹ Requires adjusted SSEG regulations (proposed lifting licensing requirement for SSEG & only requiring registration with NERSA - from 1 MW to 10 MW (or more)); ² Does not require regulatory changes (just communications rollout but could be further incentivised by Eskom/municipalities); ³ Will require Ministerial Determination - generators expected to be >10 MW (technologies should be aligned with IRP 2019)

Manage short-term needs with the range of options from Step 1 whilst RfI process runs in Step 2 (many dispatchable options likely to be available)

Step 2 (addressing short-term adequacy and setting up for long-term expected energy mix)

- DMRE Risk Mitigation Power Purchase Procurement Programme (RMPPPP) RfI
- RfI (and resulting RfP) should assist to fill gap following Step 1 (customer response at scale)
- Reality: Only likely to come online from 2021 onwards
- Capacity providers expected to be >10 MW - licensing & ministerial approval (technologies aligned with IRP 2019)
- Can also include some of the options in Step 1

- Options could include (from 2021 onwards):
 - Standby Gx aggregator¹: 200-1000 MW/yr
 - Emergency Gx^{2,3}: 500-2000 MW/yr
- Structural loadshedding: Stage 3: 3000 MW; Stage 4: 4000 MW


NOTES: Gx – Generation; com. – Commercial; ind. – Industrial; min. – mining; agri. – Agricultural; res. – Residential; DSR – Demand Side Response; ¹ Requires adjusted SSEG regulations (proposed lifting licensing requirement for SSEG & only requiring registration with NERSA - from 1 MW to 10 MW (or more)); ² Will require Ministerial Determination - generators expected to be >10 MW (technologies should be aligned with IRP 2019 but could include temporary/permanent engines, OCGTs, cogeneration, imports etc.);

³ Will require fast-tracked procurement process.

DMRE Rfi is needed & important but is only part of the puzzle and a component of the supply/demand options that will be needed

DMRE Request for Information (Rfi)

- Request for Risk Mitigation Power Purchase Procurement (Generation)
- Released: **13 December 2019**
- Briefing Session: **8 January 2020**
- Response: **31 January 2020**
- Specification:
 - Quantity: 2000 – 3000 MW
 - Can include supply-side and demand-side options
 - Lead-time: 3-6 months (2000 MW), 6-12 months (3000 MW)
 - PPA tenure: 3 years, 5 years, 10 years, 15 year, 20 years
 - Type: “Baseload Energy”, “Peaking Energy”, “Mid-Merit Energy”
 - Regime: “Dispatchable”, “Self-Dispatchable”
- RfP to follow once Rfis have been assessed

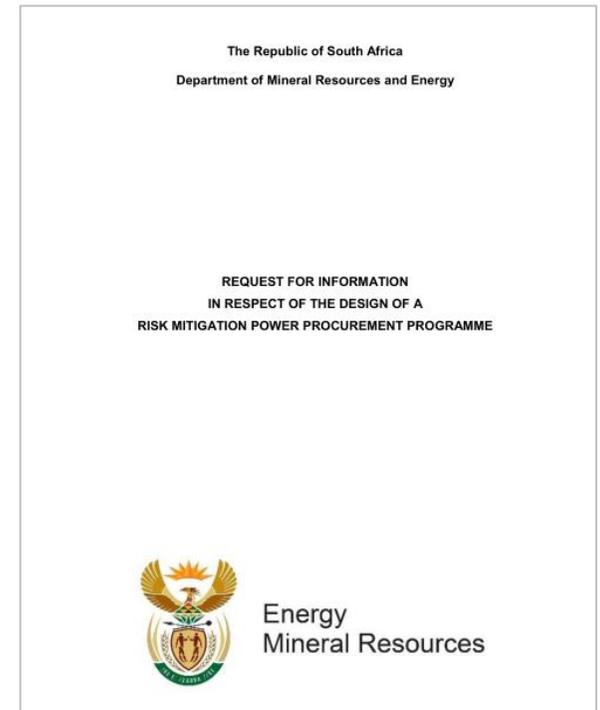


Step 3 to setup for the 2020s - immediately run procurement rounds aligned with IRP 2019 & consider reductions based on Step 1 & 2 deployments

Step 3 (continued implementation of IRP 2019)

- Immediate Ministerial Determinations aligned with IRP 2019
- Begin next procurement rounds for new capacity (lead-times necessitate this)
- Reality: Only likely to come online from 2022 onwards (more likely 2023-2024)
- Options as defined by IRP 2019 (should likely be subtracted from capacity already deployed in Step 1 and Step 2):
 - Wind: 1 600 MW (2022) Wind: 14 400 MW (2030)
 - Solar PV: 1 000 MW (2022) Solar PV: 6 000 MW (2030)
 - Coal: 750 MW (2023) Coal: 1 500 MW (2030)
 - EG/DG: 500 MW (2023) EG/DG: 4 000 MW (2030)
 - Gas: 1 000 MW (2024) Gas: 3 000 MW (2030)
 - Storage: 513 MW (2022) Storage: 2 088 MW (2030)

IRP 2019 scenario and roll out of step 1, daytime energy shortages & diesel burn substantially reduced, but load shedding still required

IRP 2019 with customer response at scale options (Step 1) options: Simulated hourly generation for 2 weeks in 2021

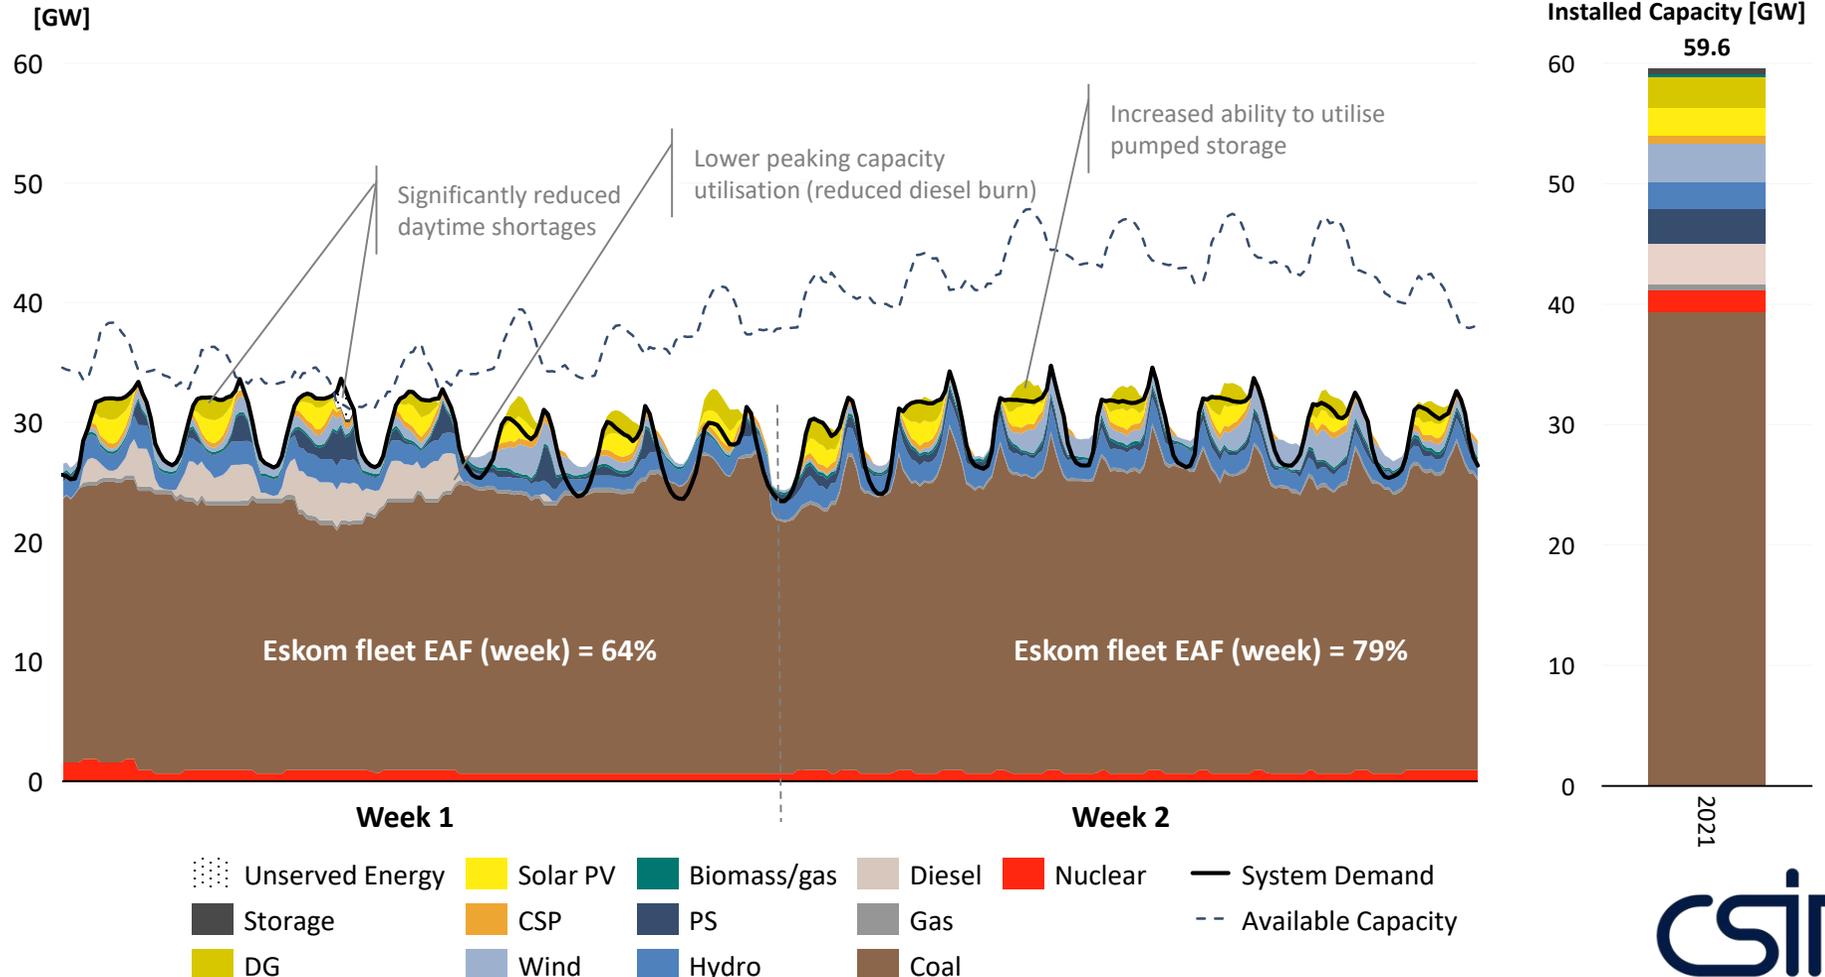


NOTE: Lower end of total estimated capacity in Step 1 is considered in scenarios; Representative week(s) shown but entire time horizon is simulated at hourly resolution in production cost model applying unit commitment and economic dispatch principles; Sources: CSIR Energy Centre analysis


IRP 2019 comparison with customer response at scale options (Step 1) revealing notably less constrained power system

Simulated hourly generation of the total power supply in RSA for 1 week in April 2021

IRP 2019

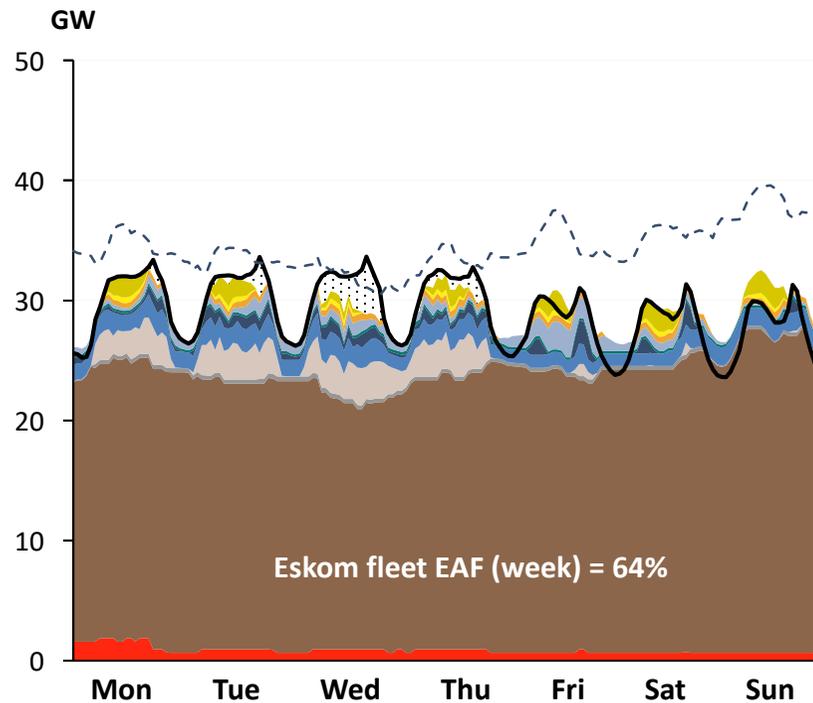

IRP 2019 with customer response at scale (Step 1)

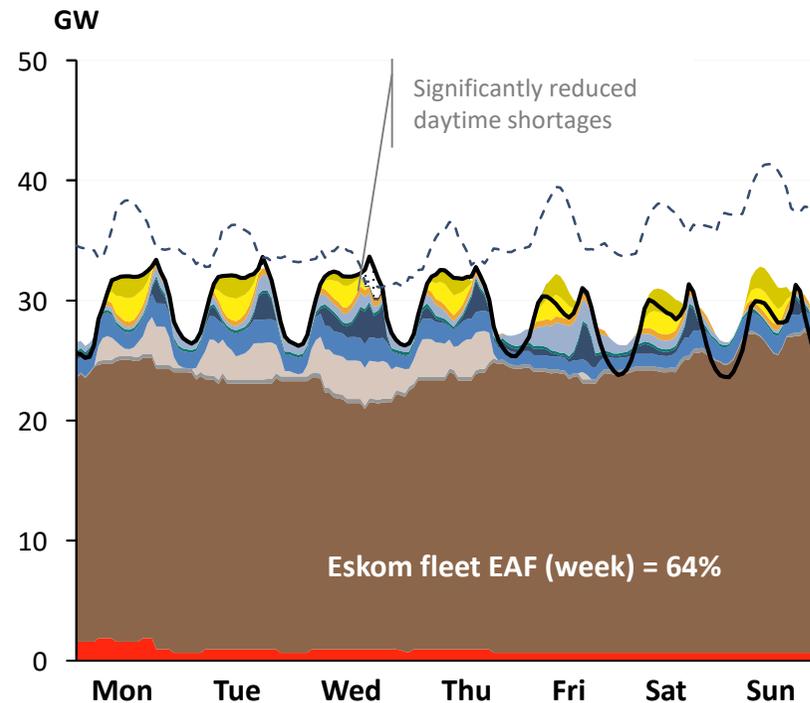

- ⋯ Unserved Energy
- DG
- CSP
- Biomass/gas
- Hydro
- Gas
- Nuclear
- System Demand
- Storage
- Solar PV
- Wind
- PS
- Diesel
- Coal
- Available Capacity

IRP 2019 scenario (where improved EAF occurs) that is supplemented by customer response (Step 1) will then require mostly capacity (less energy)

What is still needed to ensure system adequacy (utilising DMRE RMPPPP RfI/RfP process)? (Step 2)

- Capacity¹: 1.3 GW (2021), 0.1-1.2 GW (2022-2025)
- Capacity factor <3%

NOTE:

- This scenario assumes IRP 2019 EAF & IRP 2019 demand forecast:
 - EAF recovery from ≈67% in 2019 to 75.5% by 2024
 - Demand forecast immediately growing to 284 TWh by 2025
- If lower customer response at scale (Step 1), additional energy will be needed (higher capacity factor)
- Structural loadshedding (Stage 3 & Stage 4) may also be necessary during 2020-2021


¹ It is assumed that capacity from Step 2 will only come online in 2021 (owing to procurement process & technology lead times);
Sources: CSIR Energy Centre analysis

IRP 2019 comparison with customer response (Step 1) and DMRE RMPPPP (Step 2) revealing capacity needs met (notably less constrained system)

Simulated hourly generation of the total power supply in RSA for 1 week in April 2021


IRP 2019

with customer response at scale (Step 1)

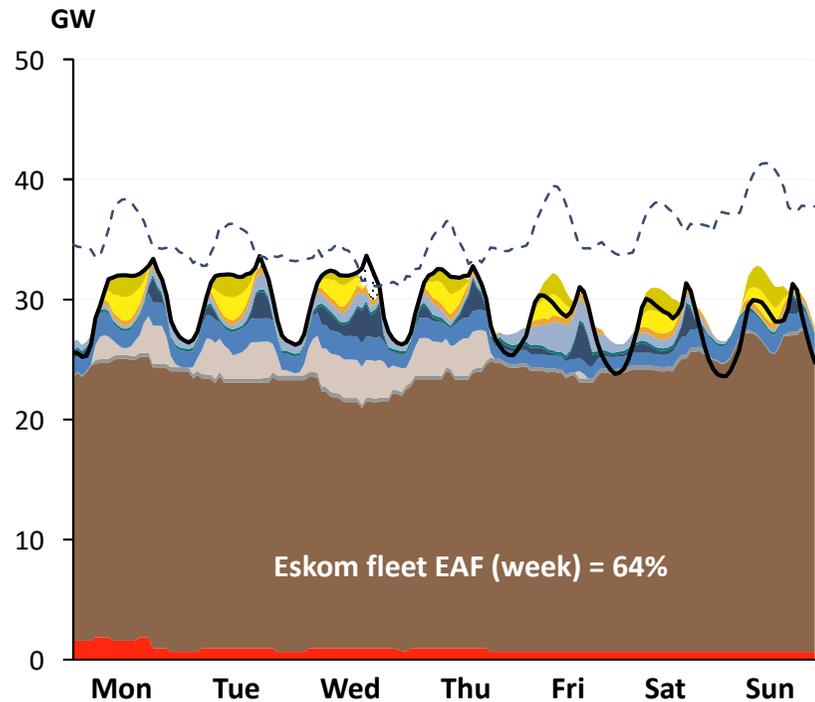

IRP 2019

with customer response (Step 1) and DMRE RMPPPP (Step 2)

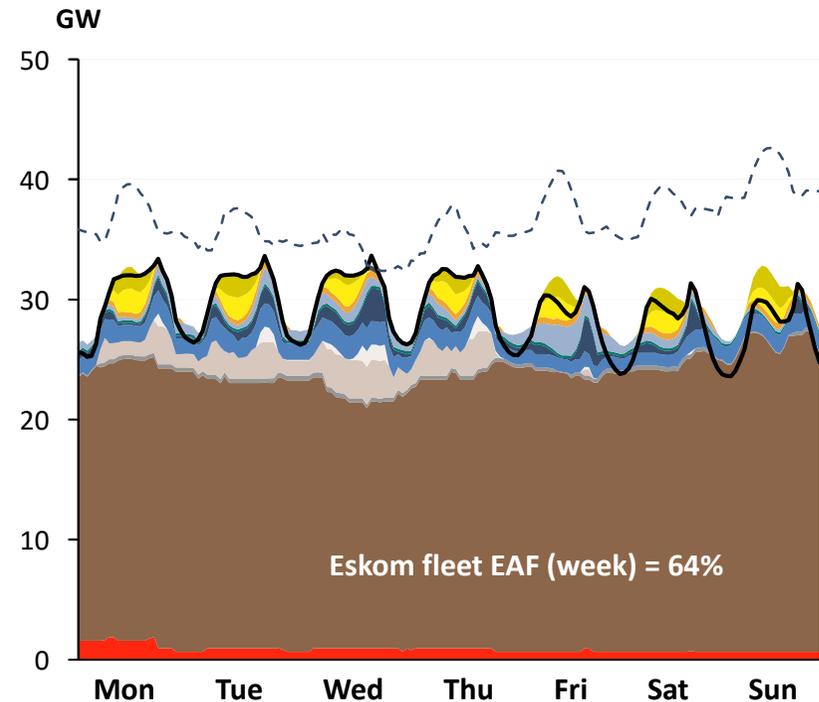


Unserved Energy
 DG
 CSP
 Biomass/gas
 Hydro
 Diesel
 Coal
 System Demand

Storage
 Solar PV
 Wind
 PS
 DMRE
 Gas
 Nuclear
 Available Capacity

Updated scenario - with updated EAF & demand, with customer response (Step 1) reduces daytime shortages & diesel burn, but load shedding remains

Updated scenario with customer response at scale options (Step 1): Simulated hourly generation for 2 weeks in 2021

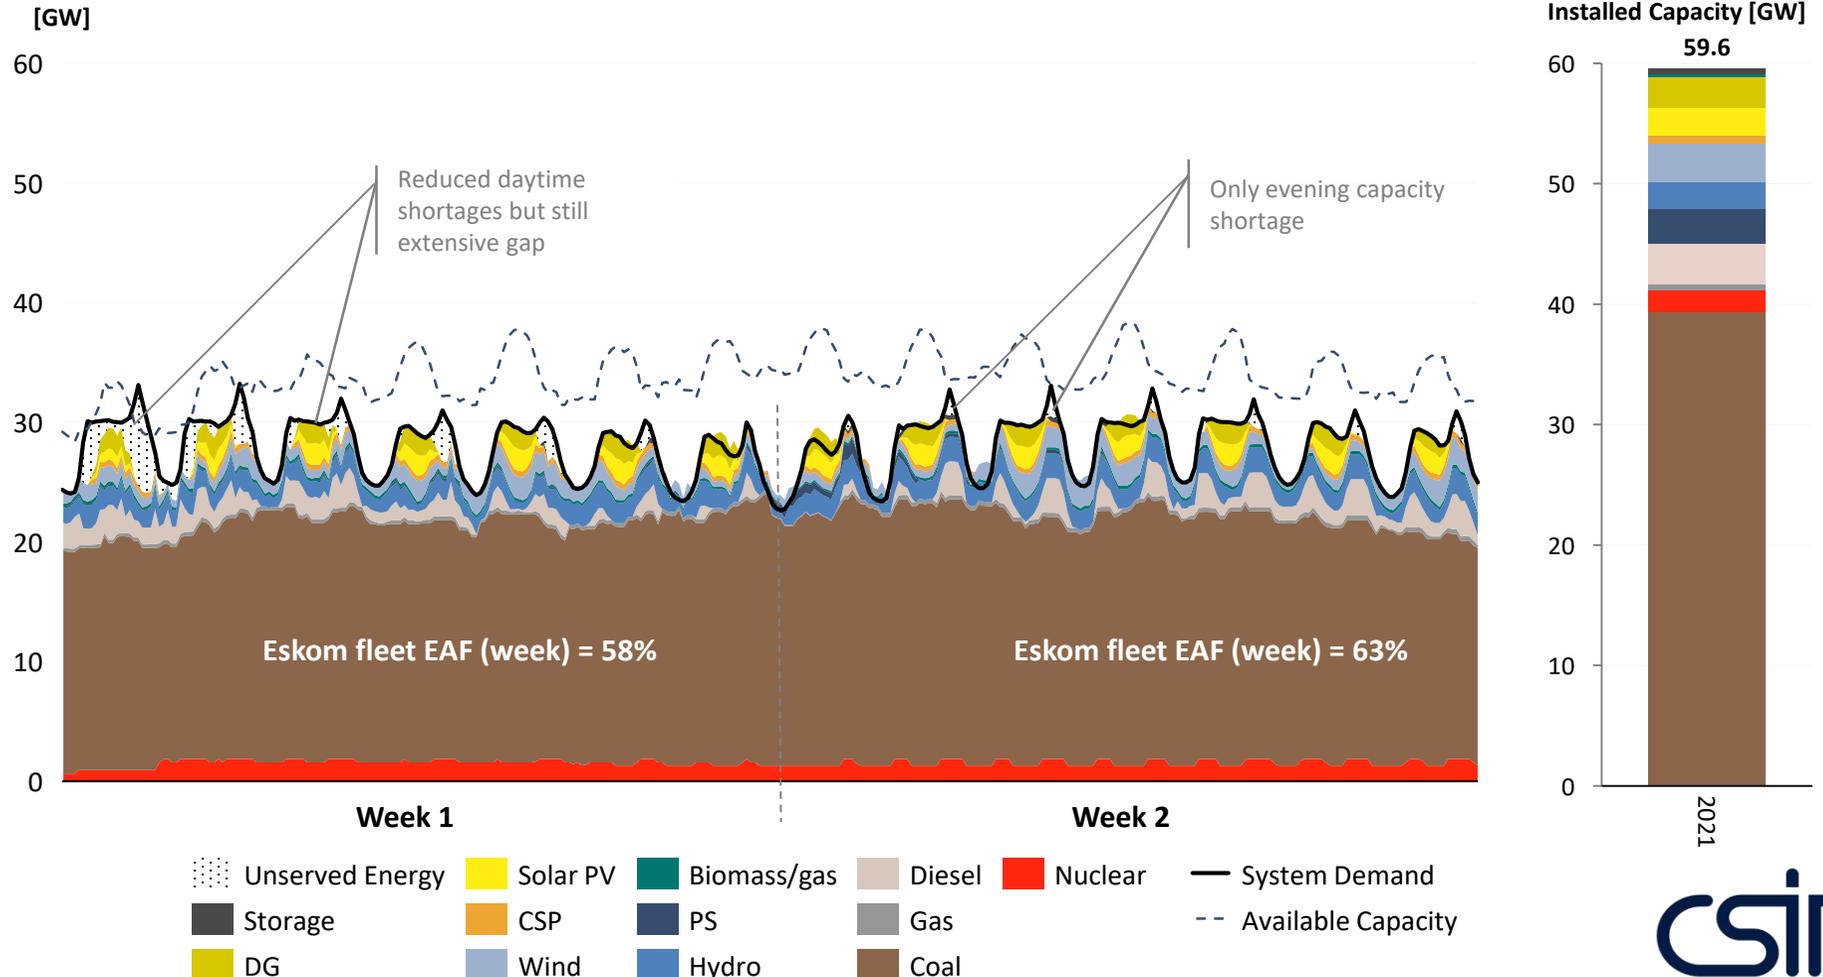


NOTE: Lower end of total estimated capacity in Step 1 is considered in scenarios; Representative week(s) shown but entire time horizon is simulated at hourly resolution in production cost model applying unit commitment and economic dispatch principles; Sources: CSIR Energy Centre analysis


Updated scenario shows significantly less constrained system with the roll out of customer response at scale (Step 1)

Simulated hourly generation of the total power supply in RSA for 1 week in 2021

Updated scenario

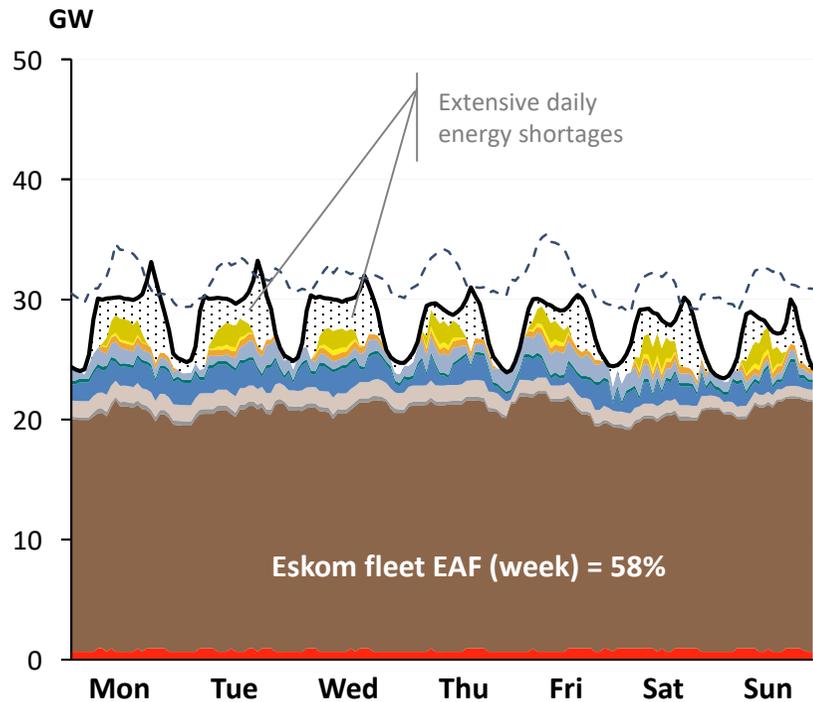

Updated scenario with customer response at scale (Step 1)

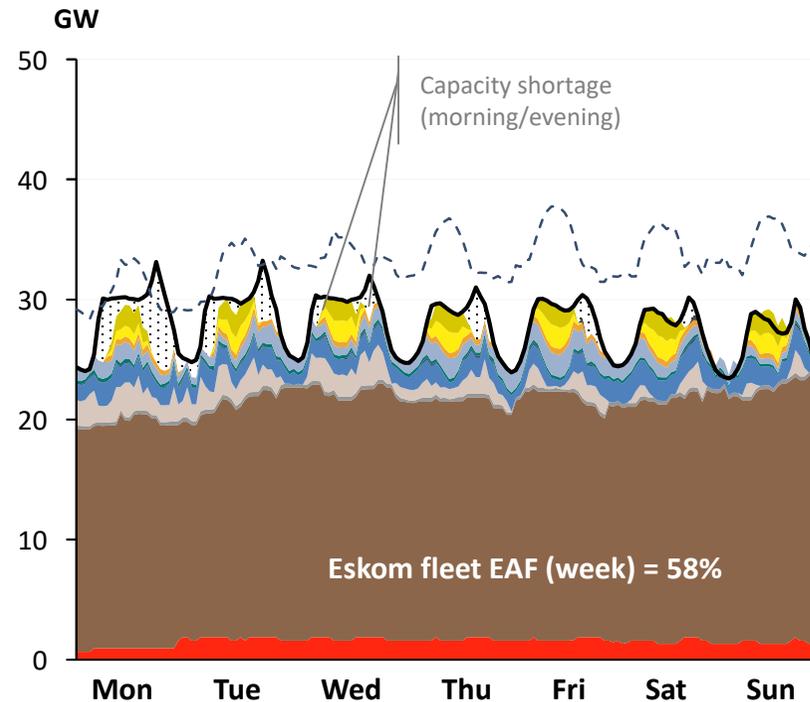

Unserved Energy
 DG
 CSP
 Biomass/gas
 Hydro
 Gas
 Nuclear
 System Demand

Storage
 Solar PV
 Wind
 PS
 Diesel
 Coal
 Available Capacity

Updated scenario will require significant additional capacity & energy through to 2025 in addition to customer response at scale (Step 1)

Now... What is still needed to ensure system adequacy (utilising DMRE RMPPPP RfI/RfP process)? (Step 2)

- Capacity¹: 2.8 GW (2021), 1.9 GW (2022) and 1.6-3.9 GW (2023-2025)
- Capacity factor 8% (2021), 10% (2022), 1-3% (2023-2025)

NOTE:


- This scenario assumes an Updated EAF & demand forecast:
 - EAF from ≈67% in 2019 to ≈65% by 2025
 - Demand forecast initially flat & growth to 267 TWh by 2025
- If lower customer response at scale (Step 1), additional energy will be needed (higher capacity factor)
- Structural low-level loadshedding (Stage 3 & Stage 4) may also be necessary during 2020-2021

¹ It is assumed that capacity from Step 2 will only come online in 2021 (owing to procurement process & technology lead times);
Sources: CSIR Energy Centre analysis


Updated scenario comparison of customer response (Step 1) and additional DMRE RMPPPP (Step 2) revealing notably less constrained power system

Simulated hourly generation of the total power supply in RSA for 1 week in 2021

Updated scenario
with customer response at scale (Step 1)

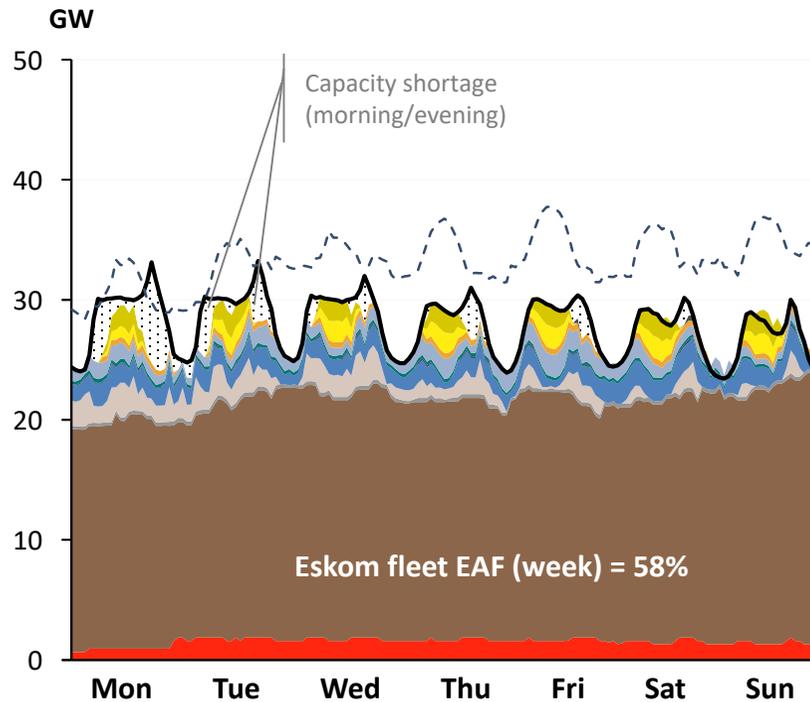

Updated scenario
with customer response (Step 1) and DMRE RMPPPP (Step 2)

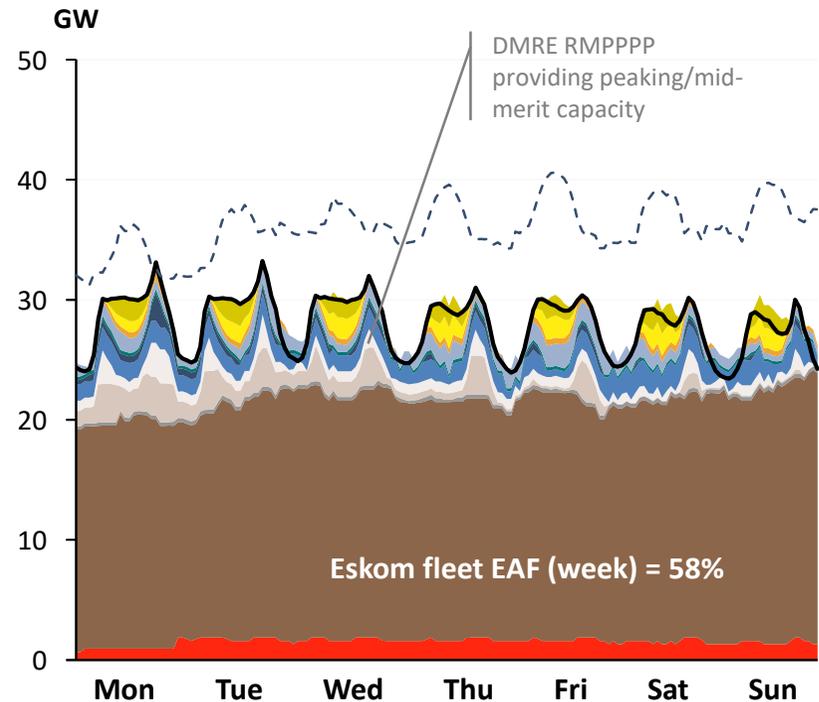

Unserved Energy
 DG
 CSP
 Biomass/gas
 Hydro
 Diesel
 Coal
 System Demand
 Storage
 Solar PV
 Wind
 PS
 DMRE
 Gas
 Nuclear
 Available Capacity

Thank you

References

Loadshedding data

- Eskom twitter account: https://twitter.com/Eskom_SA
- ESP (Twitter app): <https://sepush.co.za/>
- National Energy Regulator of South Africa (NERSA). (2008). Inquiry Into the National Electricity Supply Shortage and Load Shedding. Retrieved from <http://pmg-assets.s3-website-eu-west-1.amazonaws.com/docs/080528nersa.pdf>

COUE

- Department of Energy (DoE). (2019). Integrated Resource Plan (IRP 2019). Retrieved from http://www.greengazette.co.za/pages/national-gazette-37230-of-17-january-2014-vol-583_20140117-GGN-37230-003

Eskom fleet Energy Availability Factor (EAF)

- Eskom Annual Reports: <http://www.eskom.co.za/OurCompany/Investors/IntegratedReports>
- MTSAO: Fabricius, C., Sigwebela, N., Damba, S., Mdhluli, S., & Rambau, P. (2019). MEDIUM-TERM SYSTEM ADEQUACY OUTLOOK. Retrieved from <http://www.eskom.co.za/Whatweredoing/SupplyStatus/Documents/MediumTermSystemAdequacyOutlook2019.pdf>
- Eskom System Adequacy Reports: <http://www.eskom.co.za/Whatweredoing/SupplyStatus>
- Department of Energy (DoE). (2019). Integrated Resource Plan (IRP 2019). Retrieved from http://www.greengazette.co.za/pages/national-gazette-37230-of-17-january-2014-vol-583_20140117-GGN-37230-003
- Department of Energy (DoE). (2018). *INTEGRATED RESOURCE PLAN 2018*. Retrieved from <http://www.energy.gov.za/IRP/irp-update-draft-report2018/IRP-Update-2018-Draft-for-Comments.pdf>

References

Capacity and energy mix to 2030 (IRP 2019)

- Department of Energy (DoE). (2019). Integrated Resource Plan (IRP 2019). Retrieved from http://www.greengazette.co.za/pages/national-gazette-37230-of-17-january-2014-vol-583_20140117-GGN-37230-003

DMRE Risk Mitigation Power Purchase Procurement Programme (RMPPPP) Rfi

- Department of Mineral Resources and Energy (DMRE). (2019). REQUEST FOR INFORMATION IN RESPECT OF THE DESIGN OF A RISK MITIGATION POWER PROCUREMENT PROGRAMME. Retrieved from [http://www.energy.gov.za/files/docs/MTPPP%20Generation%20-%20DMRE%20Request%20For%20Information%20\(13%20December%202019\).pdf](http://www.energy.gov.za/files/docs/MTPPP%20Generation%20-%20DMRE%20Request%20For%20Information%20(13%20December%202019).pdf)

Disclaimer

© CSIR 2020. All rights to the intellectual property and/or contents of this document remain vested in the CSIR. This document is issued for the sole purpose for which it is supplied. CSIR will take no responsibility or incur any liability for the use of the information contained herein if used for any other purpose. No part of this publication may be reproduced, stored in a retrieval system or transmitted, in any form or by means electronic, mechanical, photocopying, recording or otherwise without the express written permission of the CSIR. It may also not be resold, hired out or otherwise disposed of by way of trade in any form of binding or cover than that in which it is published.
